



CONTRA COSTA

CONSERVATION & DEVELOPMENT

Planning Application Summary

County File Number: CDVR24-01060

File Date: 12/19/2024

Applicant:

GEORGE P JR TRE NAVARRO NAVARRO gnavarropj@gmail.com
 GEORGE P JR TRE (650) 333-3933
 5936 JENNY LIND CT
 SAN JOSE, CA 951201789

Property Owner:

GEORGE P JR TRE NAVARRO gnavarropj@gmail.com
 5936 JENNY LIND CT (650) 333-3933
 SAN JOSE, CA 951201789

Project Description:

The applicant requests a variance application to allow for a new oversized detached garage of 750 sq ft (where 600 sq ft is the maximum size) and to allow a 15'-5" height (where 15 feet is the maximum height). The project also includes a small lot design review for the garage for substandard average width (50 feet where 60 feet is required). (Code enforcement CECF24-0403)

Project Location: (Address: 3565 WILLOW RD, BETHEL ISLAND, CA 945110447), (APN: 029100014)


Additional APNs:

General Plan Designation(s): RLM	Zoning District(s): "F-1, -FH"
Flood Hazard Areas: AE	AP Fault Zone:
60-dBA Noise Control:	MAC/TAC: Bethel Island MAC
Sphere of Influence:	Fire District: CONSOLIDATED FIRE Former ECC
Sanitary District: IRONHOUSE SANITARY	Housing Inventory Site: NO
Specific Plan:	

Fees:

Fee Item	Description	Account Code	Total Fee	Paid
052B	Notification Fee (\$30)	002606-9660-REV-000-5B052B	30.00	30.00
066A	Late Filing Penalty	002606-9660-REV-000-5B066A	1625.00	1625.00
VRS0044	Zone Variance - DCD	002606-9660-REV-000-5B0044	3250.00	3250.00
VRS0044P	Zone Variance - PW	000651-9660-REV-000-6L0044	1000.00	1000.00
Total:			5905.00	5905.00

Aerial

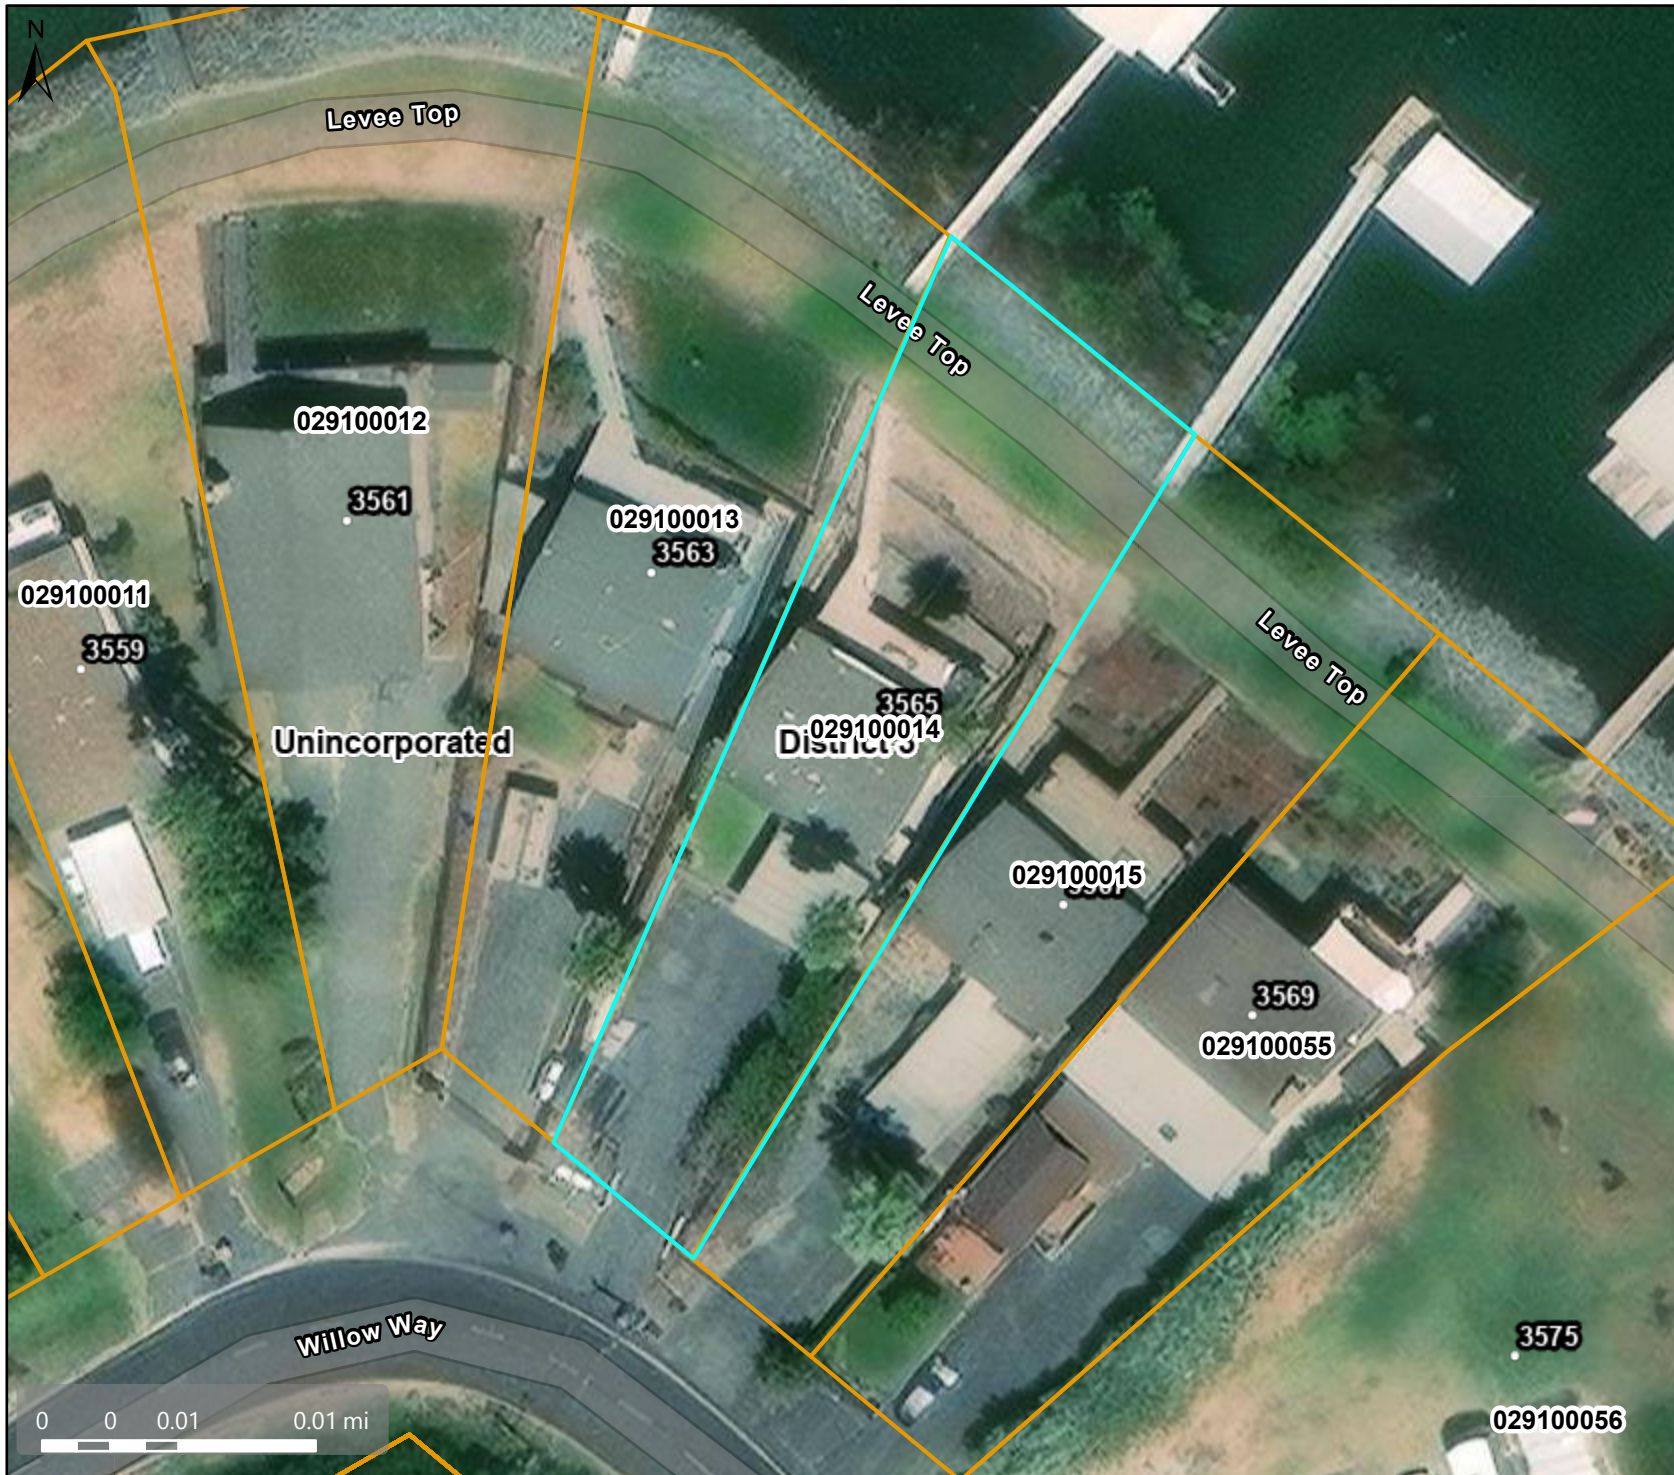

Map Legend

- Assessment Parcels
- Planning Layers (DCD)
 - Unincorporated
 - Board of Supervisors' Districts
- Base Data
 - Address Points

This map is a user generated, static output from an internet mapping application and is intended for reference use only. Data layers that appear on this map may or may not be accurate, current, or otherwise reliable. THIS MAP IS NOT TO BE USED FOR NAVIGATION. CCMAP is maintained by Contra Costa County Department of Information Technology, County GIS. Data layers contained within the CCMAP application are provided by various Contra Costa County Departments. Please direct all data inquiries to the appropriate department.

Spatial Reference
PCS: WGS 1984 Web Mercator Auxiliary Sphere
Datum: WGS 1984

General Plan - RLM



Map Legend


- Assessment
Parcels
- Planning Layers
(DCD)**
- General Plan**
- RLM
(Residential
Low-Medium
Density) (3-7
du/na)
- WA (Water)
- Unincorporated
- Board of
Supervisors'
Districts
- Base Data**
- Address Points

This map is a user generated, static output from an internet mapping application and is intended for reference use only. Data layers that appear on this map may or may not be accurate, current, or otherwise reliable.

THIS MAP IS NOT TO BE USED FOR NAVIGATION.

CCMap is maintained by Contra Costa County Department of Information Technology, County GIS. Data layers contained within the CCMap application are provided by various Contra Costa County Departments. Please direct all data inquires to the appropriate department.

Spatial Reference
 PCS: WGS 1984 Web Mercator Auxiliary Sphere
 Datum: WGS 1984

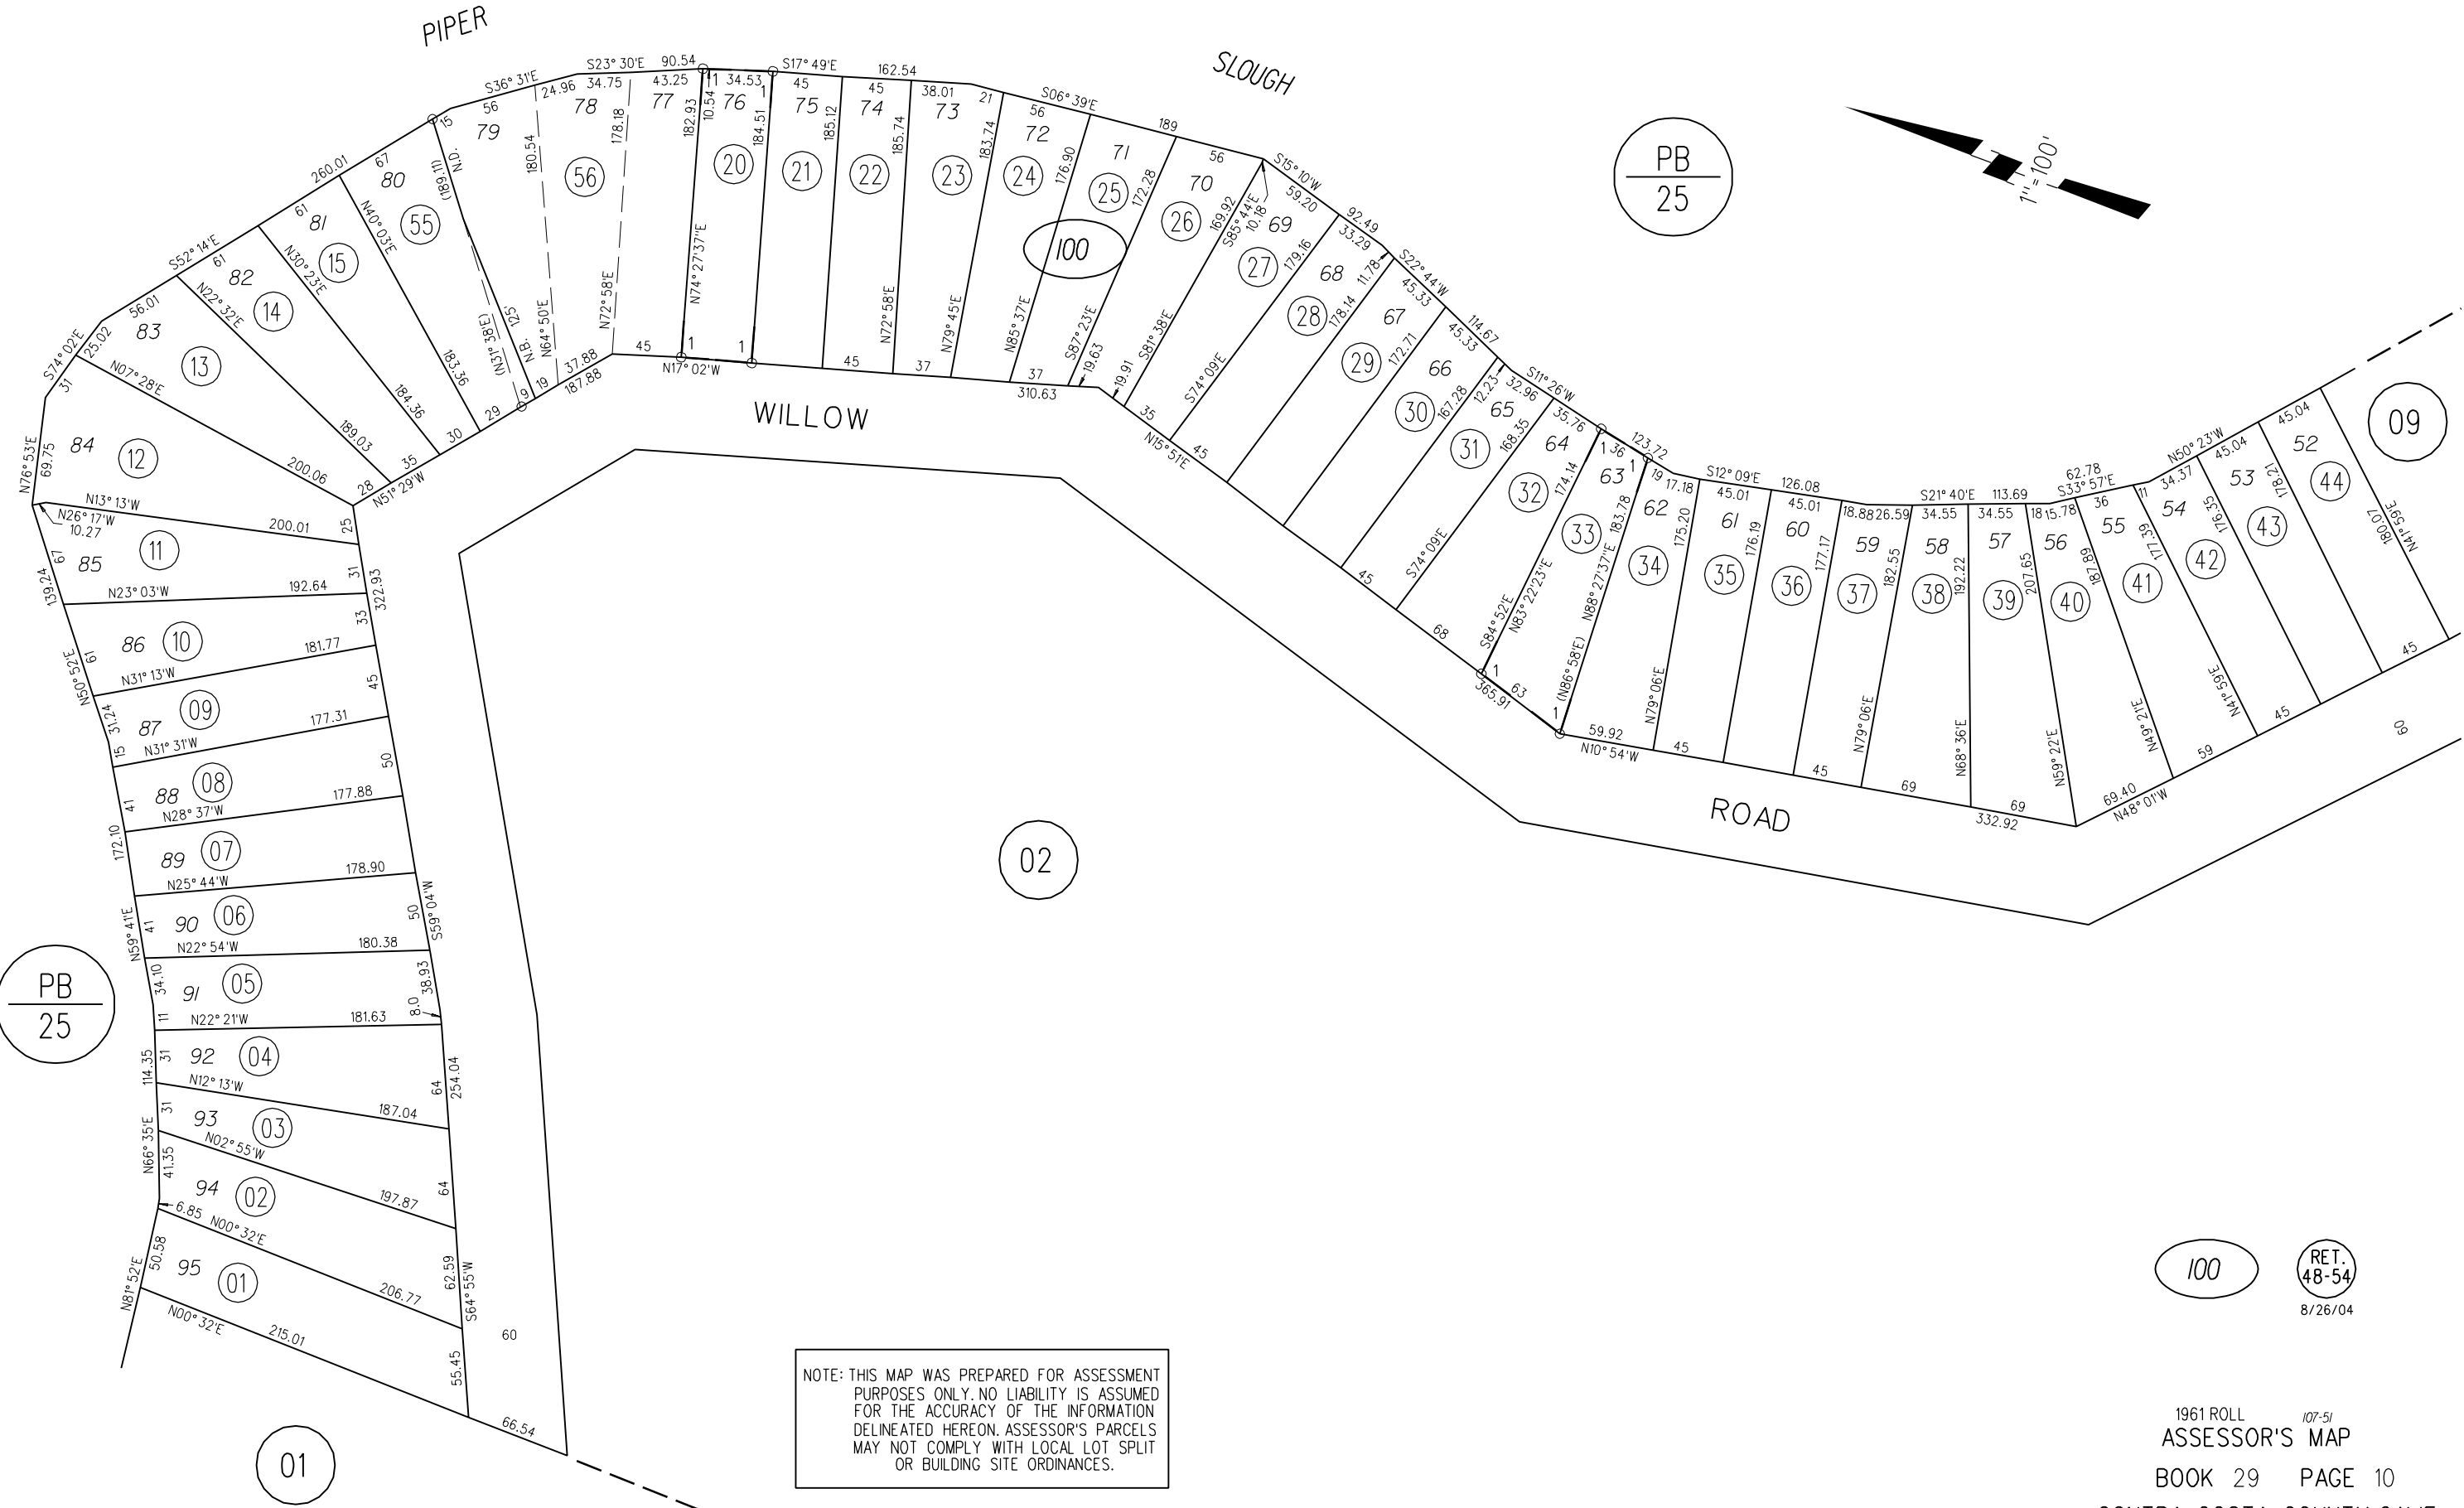

NOTE: THIS MAP WAS PREPARED FOR ASSESSMENT PURPOSES ONLY. NO LIABILITY IS ASSUMED FOR THE ACCURACY OF THE INFORMATION DELINEATED HEREON. ASSESSOR'S PARCELS MAY NOT COMPLY WITH LOCAL LOT SPLIT OR BUILDING SITE ORDINANCES.

100 RET. 48-54 8/26/04

Zoning - F-1, -FH



Map Legend

- Assessment
Parcels
- Planning Layers
(DCD)**
- Zoning**
- ZONE_OVER**
- F-1 (Water
Recreational)
- F-1 -FH (Flood
Hazard
Combining
District)
- T-1 -FH (Flood
Hazard
Combining
District)
- Unincorporated
- Board of
Supervisors'
Districts
- Base Data**
- Address Points

This map is a user generated, static output from an internet mapping application and is intended for reference use only. Data layers that appear on this map may or may not be accurate, current, or otherwise reliable.

THIS MAP IS NOT TO BE USED FOR NAVIGATION. CCMMap is maintained by Contra Costa County Department of Information Technology, County GIS. Data layers contained within the CCMMap application are provided by various Contra Costa County Departments. Please direct all data inquiries to the appropriate department.

Spatial Reference
PCS: WGS 1984 Web Mercator Auxiliary Sphere
Datum: WGS 1984

NAVARRO RESIDENCE

3565 WILLOW ROAD, BETHEL ISLAND, CA

HOMEOWNER: GEORGE AND CLAUDIA NAVARRO
3565 WILLOW RD. BETHEL ISLAND 94511
650.359.3493
650.444.0126
CLAU@COMCAST.NET

DESIGNER: JENNIFER D. BROWN
JB DRAFTING & DESIGN
925.992.3090
JENBROWN@JBDRAFTINGDESIGN.COM
P.O. BOX #2735, DUBLIN, CA 94566

APN: 0291000141
OCCUPANCY TYPE: R-3/U
CONSTRUCTION TYPE: VB
FIRE SPRINKLERS: NO

SCOPE OF PROJECT: PERMIT PREVIOUSLY UNPERMITTED GARAGE

LOT COVERAGE & FLOOR AREA RATIO:

LOT AREA	9,250 SF
(E) RESIDENCE (LOWER FLOOR)	757 SF
(E) GARAGE/UTILITY	750 SF
TOTAL LOT COVERAGE (16%)	1,507 SF

IMPERVIOUS SURFACES:

LOT AREA	9,250 SF
BLG FOOTPRINT	1,507 SF
DRIVEWAY & WALKWAYS	2,624 SF
TOTAL SURFACE AREA (45%)	4,136 SF

INDEX:

A1	GENERAL NOTES & SITE PLAN
A2	GARAGE FOUNDATION AND ELECTRICAL PLAN
1	COVER SHEET
2	ELEVATIONS
3	ANCHORAGE PLAN, REACTIONS AND NOTES
3B	ANCHORAGE TO AS-BUILT NOTES
4	COLUMN LAYOUT PLAN AND DETAILS
5	FRAME SECTION AND DETAILS
6	SIDEWALL FRAMING AND DETAILS
7	END WALL FRAMING AND DETAILS

CODES AND GENERAL NOTES:
2022 CALIFORNIA BUILDING CODE
2022 CALIFORNIA RESIDENTIAL CODE
2022 CALIFORNIA MECHANICAL CODE
2022 CALIFORNIA PLUMBING CODE
2022 CALIFORNIA FIRE CODE
2022 CALIFORNIA ENERGY CODE
2022 CALIFORNIA ELECTRIC CODE
2022 TITLE 24 ENERGY STANDARDS
2022 CALIFORNIA GREEN BUILDING STANDARDS AND ANY OTHER APPLICABLE LOCAL, STATE AND FEDERAL LAWS AND REGULATIONS.
THE CALIFORNIA BUILDING STANDARDS CODE IS BASED ON 2021 IBC, 2021 UFG, AND 2021 NEC.
PLANS MUST COMPLY WITH LOCAL SECURITY ORDINANCES & ALL LOCAL MUNICIPAL ORDINANCES AND ALL LOCAL BUILDING CODES.

ALL WOOD CONSTRUCTED SHALL BE #1 D.F. UNLESS OTHERWISE NOTED.
ALL DIMENSIONS TO BE VERIFIED IN FIELD.
EGRESS WINDOWS SHALL HAVE THE BOTTOM OF THE CLEAR OPENINGS 44" AFF.
GRADING AND PAVING: SURFACE WATER SHALL BE MANAGED TO DRAIN AWAY FROM BUILDINGS.
USE SPLASH BLOCKS OR OTHER DIVERTERS TO DIRECT STORM WATER INTO LANDSCAPING.
STORM WATER DRAINAGE AND RETENTION DURING CONSTRUCTION; STRAW WADDLES SURROUNDING AREA OF CONSTRUCTION SHALL BE APPLIED TO MANAGE STORM WATER AND DRAINAGE DURING CONSTRUCTION.

DISCLAIMER:
DRAWINGS, NOTES, AND DIMENSIONS ARE AN AID TO THE CONTRACTOR IN UNDERSTANDING THE WORK AND SHOULD NOT BE CONSTRUED AS COMPLETE IN EVERY DETAIL. IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO VISIT THE SITE, BECOME THOROUGHLY FAMILIAR WITH THE WORK AND BRING ALL DISCREPANCIES BETWEEN THE DRAWINGS AND THE ACTUAL JOB CONDITIONS TO THE ATTENTION OF THE OWNER, THE OWNER'S REPRESENTATIVE OR THE DESIGNER AS APPROPRIATE. THE CONTRACTOR SHALL CORRELATE WORK BETWEEN ARCHITECTURAL, DESIGN, SPECIFICATIONS AND CONSULTANT DRAWINGS. REPORT ALL DISCREPANCIES ENCOUNTERED TO THE OWNER, THE OWNER'S REPRESENTATIVE OR THE DESIGNER AS APPROPRIATE AND AVOID SOLUTION OF ITEMS AFFECTED BEFORE PROCEEDING.

RESIDENTIAL MANDATORY MEASURES:

BUILDING MEETS OR EXCEEDS THE REQUIREMENTS OF THE CALIFORNIA BUILDING ENERGY EFFICIENCY STANDARDS.
STORM WATER DRAINAGE AND RETENTION SHALL BE IMPLEMENTED DURING CONSTRUCTION.
SURFACE WATER SHALL BE MANAGED TO DRAIN AWAY FROM BUILDING.
PLUMBING FIXTURES AND FITTINGS INSTALLED IN RESIDENTIAL BUILDINGS SHALL COMPLY WITH THE PRESCRIPTIVE REQUIREMENTS OF SECTIONS 4303.1 THROUGH 4303.1.4.4.
SINGLE SHOWERHEADS SHALL HAVE A MAX. FLOW RATE OF NOT MORE THAN 1.8 GPM AT 80 PSI.
SHOWERHEADS SHALL BE CERTIFIED TO THE PERFORMANCE CRITERIA OF THE U.S. EPA WATERSENSE SPECIFICATION FOR SHOWERHEADS.
THE MAX FLOW RATE OF RESIDENTIAL LAVATORY FAUCETS SHALL NOT EXCEED 1.2 GPM AT 60 PSI.
THE MIN. FLOW RATE OF RESIDENTIAL LAVATORY FAUCETS SHALL NOT BE LESS THAN 0.8 GPM AT 20 PSI.
THE MAX FLOW RATE OF KITCHEN FAUCETS SHALL NOT EXCEED 1.8 GPM AT 60 PSI.
AUTOMATIC IRRIGATION SYSTEM CONTROLLERS INSTALLED AT THE TIME OF FINAL INSPECTION SHALL BE WEATHER OR SOIL MOISTURE-BASED.
ANNULAR SPACES AROUND PIPES, ELECTRIC CABLES, CONDUITS OR OTHER OPENINGS IN SOLE/BOTTOM PLATES AT EXTERIOR WALLS SHALL BE PROTECTED AGAINST THE PASSAGE OF RODENTS BY CLOSING SUCH OPENINGS WITH CEMENT MORTAR, CONCRETE MASONRY OR A SIMILAR METHOD ACCEPTABLE TO THE ENFORCING AGENCY.
RECYCLE AND/OR SALVAGE FOR REUSE A MINIMUM OF 50% OF THE NON-HAZARDOUS CONSTRUCTION AND DEMOLITION WASTE IN ACCORDANCE WITH ONE OF THE FOLLOWING:
1. COMPLY WITH A MORE STRINGENT LOCAL CONSTRUCTION AND DEMOLITION WASTE MANAGEMENT ORDINANCE, OR
2. A CONSTRUCTION WASTE MANAGEMENT PLAN, PER SECTION 4.408.2, OR
3. A WASTE MANAGEMENT COMPANY, PER SECTION 4.408.3, OR
4. THE WASTE STREAM REDUCTION ALTERNATIVE, PER SECTION 4.408.4.
AN OPERATION AND MAINTENANCE MANUAL SHALL BE PROVIDED TO THE BUILDING OCCUPANT OR OWNER.
DUCT OPENINGS AND OTHER RELATED AIR DISTRIBUTION COMPONENT OPENINGS SHALL BE COVERED DURING CONSTRUCTION.
ADHESIVES, SEALANTS, AND CAULKS SHALL BE COMPLIANT WITH VOC AND OTHER TOXIC COMPOUND LIMITS.
PAINTS, STAINS AND OTHER COATINGS SHALL BE COMPLIANT WITH VOC LIMITS.
AEROSOL PAINTS AND COATINGS SHALL BE COMPLIANT WITH PRODUCT WEIGHTED MIR LIMITS FOR VOC AND OTHER TOXIC COMPOUNDS.
DOCUMENTATION SHALL BE PROVIDED TO VERIFY THAT COMPLIANT VOC LIMIT FINISH MATERIALS HAVE BEEN USED.
ALL CARPET SHALL MEET THE TESTING AND PROJECT REQUIREMENTS PER SEC. 4504.3. ALL CARPET CUSHION INSTALLED IN THE BUILDING INTERIOR SHALL MEET THE REQUIREMENTS OF THE CARPET AND RUG INSTITUTE'S GREEN LABEL PROGRAM. ALL CARPET ADHESIVE SHALL MEET THE REQUIREMENTS OF TABLE 4504.1.
AT LEAST 80% OF FLOOR AREA RECEIVING RESILIENT FLOORING SHALL COMPLY WITH THE REQUIREMENTS PER SEC. 4504.4.
HARDWOOD FLYNCOD, PARTICLE BOARD AND MEDIUM DENSITY FIBERBOARD (MDF) USED ON INTERIOR OR EXTERIOR OF THE BUILDING SHALL COMPLY WITH FORMALDEHYDE EMISSION LIMITS PER TABLE 4504.5.
VAPOR RETARDER AND CAPILLARY BREAK IS INSTALLED AT SLAB-ON-GRADE FOUNDATIONS.
MOISTURE CONTENT OF BUILDING MATERIALS USED IN WALL AND FLOOR FRAMING SHALL NOT EXCEED 18% BEFORE ENCLOSURE. INSULATION PRODUCTS WHICH ARE VISIBLY WET OR HAVE A HIGH MOISTURE CONTENT SHALL BE REPLACED OR ALLOWED TO DRY PRIOR TO ENCLOSURE.
BATHROOM EXHAUST FANS SHALL BE ENERGY STAR DUCTED TO OUTSIDE. UNLESS FUNCTIONING AS A COMPONENT OF A WHOLE HOUSE VENTILATION SYSTEM, BATHROOM EXHAUST FANS MUST BE CONTROLLED BY A HUMIDISTAT BETWEEN A RELATIVE HUMIDITY RANGE OF 50%-80%.
DUCT SYSTEMS ARE SIZED, DESIGNED AND EQUIPMENT IS SELECTED USING THE FOLLOWING METHODS:
1. ESTABLISH HEAT LOSS AND HEAT IN VALUES ACCORDING TO ANSI/ACCA 2 MANUAL J-2011 OR EQ.
2. SIZE DUCT SYSTEMS ACCORDING TO ANSI/ACCA 1 MANUAL D-2014 OR EQ.
3. SELECT HEATING AND COOLING EQUIPMENT ACCORDING TO ANSI/ACCA 3 MANUAL S-2014 OR EQ.
HVAC SYSTEM INSTALLERS ARE TRAINED AND CERTIFIED IN THE PROPER INSTALLATION OF HVAC SYSTEMS.
SPECIAL INSPECTORS EMPLOYED BY THE ENFORCING AGENCY MUST BE QUALIFIED AND ABLE TO DEMONSTRATE COMPETENCE IN THE DISCIPLINE THEY ARE INSPECTING.
VERIFICATION OF COMPLIANCE WITH THIS CODE MAY INCLUDE CONSTRUCTION DOCUMENTS, PLANS, SPECIFICATIONS, BUILDER OR INSTALLER CERTIFICATION, INSPECTION REPORTS, OR OTHER METHODS ACCEPTABLE TO THE ENFORCING AGENCY WHICH SHOW SUBSTANTIAL PERFORMANCE.

TYPICAL ELECTRICAL NOTES:


ALL LIGHTING SHALL BE HIGH EFFICACY.
ALL LIGHTING FIXTURES SHALL BE CONTROLLED BY EITHER A DIMMER SWITCH OR BY A VACANCY SENSOR SWITCH THAT REQUIRES A MANUAL ON ACTIVATION AND AUTOMATICALLY TURNS OFF WITHIN 30 MINS AFTER THE ROOM IS VACATED. EXCEPT THAT BATHROOMS, LAUNDRY ROOM, GARAGES AND UTILITY ROOMS SHALL HAVE ON LIGHT FIXTURE CONTROLLED BY A VACANCY SENSOR. ALL OTHER LIGHTING IN THESE ROOMS SHALL BE CONTROLLED BY A VACANCY SENSOR OR A DIMMER SWITCH. ALL LIGHT FIXTURES SHALL CONTAIN BULBS THAT ARE LABELED AS JAB-2016. SCREW BASE BULBS ARE PERMITTED EXCEPT IN RECESSED LIGHTING FIXTURES.
EXTERIOR LIGHTING AFFIXED TO THE RESIDENCE SHALL BE CONTROLLED BY A MANUAL ON/OFF SWITCH. WATER/WEATHER PROOF & SHALL BE HIGH EFFICACY IN ADDITION TO INCLUDE ONE OF THE FOLLOWING:
A. PHOTOCELL & MOTION SENSOR, OR
B. PHOTOCONTROL & AUTOMATIC TIME SWITCH CONTROL, OR
C. ASTRONOMICAL TIME CLOCK CONTROL, OR
D. ENERGY MANAGEMENT CONTROL SYSTEM.
LUMINARIES THAT ARE TO BE RECESSED INTO INSULATED CEILING SHALL BE IC-RATED, AIR-TIGHT, SEALED/CAULKED BETWEEN THE FIXTURE HOUSING AND CEILING. SHALL NOT CONTAIN A SCREW BASE SOCKET AND CONTAIN BULBS MARKED WITH JAB-2016-E EFFICIENCY LABEL. RECESSED LUMINARIES SHALL BE CONTROLLED BY DIMMERS OR VACANCY SENSOR. RECESSED LUMINARIES SHALL COMPLY WITH THE REFERENCE JOINT APPENDIX JAB AND SHALL NOT CONTAIN SCREW BASE SOCKETS IN ADDITION TO BEING CONTROLLED BY A DIMMER SWITCH OR VACANCY SENSOR.
ALL 125 VOLT 15 & 20 AMP RECEPTACLES SHALL BE TAMPER-RESISTANT RECEPTACLES.
ELECTRICAL OUTLETS IN KITCHEN, LAUNDRY & BATH SHALL BE 15 AMP, 120V W/ DUAL FUNCTION (GFCI & AFCI).
ALL OUTLETS WITHIN 6' FEET OF A SINK SHALL HAVE GFCI PROTECTION.
A 120-VOLT RECEPTACLE OUTLET REQUIRED AT WASHING MACHINE IN LAUNDRY AREA.
A DEDICATED 20-AMP OUTLET IS REQUIRED TO SERVE THE REQUIRED BATHROOM OUTLETS. THIS CIRCUIT CANNOT SUPPLY ANY OTHER RECEPTACLES, LIGHTS, FANS, ETC. (EXCEPTION--WHERE THE CIRCUIT SUPPLIES A SINGLE BATHROOM, OUTLETS FOR OTHER EQUIPMENT WITHIN THE SAME BATHROOM SHALL BE PERMITTED TO BE SUPPLIED.)

TYPICAL PLUMBING NOTES:


ALL NEW & EXISTING FIXTURES SHALL COMPLY WITH THE FOLLOWING: WATER CLOSETS: 1.28 GPF, MAX; SHOWERHEADS: 1.8 GPM, MAX @80 PSI; LAV. FAUCETS: 1.2 GPM, MAX @60 PSI; KITCHEN FAUCETS: 1.8 GPM, MAX @ 60 PSI. ANY NONCOMPLIANT PLUMBING FIXTURES THAT ARE NOT PART OF THE SCOPE OF WORK WILL BE REQUIRED TO COMPLY WITH THIS CODE SECTION.
NEW OR RECONFIGURED SHOWER STALLS SHALL BE A MIN FINISHED INTERIOR OF 1024 SQ. IN. BE CAPABLE OF ENCOMPASSING A 30 IN DIAMETER CIRCLE. ANY DOORS SHALL SWING OUT OF THE ENCLOSURE HAVE A CLEAR OPENING OF 22 IN MIN.
SHOWER STALLS AND BATHTUBS WITH SHOWER HEADS INSTALLED, SHALL HAVE WALLS FINISHED WITH A NONABSORBENT SURFACE FOR A MIN OF 6 FT. ABOVE THE FLOOR.
THE WATER CLOSET SHALL HAVE A CLEARANCE OF 30 INCHES WIDE (15 IN ON CENTER) AND 24 INCHES IN FRONT.
WHERE THE WATER CLOSET (OR OTHER PLUMBING FIXTURE) COMES INTO CONTACT WITH THE WALL OR FLOOR, THE JOINT SHALL BE CAULKED AND SEALED TO BE WATERTIGHT.
MIXED WATER TO SHOWERS, TUB-SHOWER COMBINATION SHALL BE LIMITED TO 120°F. PROVIDE WATER TEMPERING VALVE CONFORMING TO ASSE 101.6 FOR SHOWER, TUB-SHOWER COMBINATION.

GRADING AND DRAINAGE NOTES:

PROJECTS WHICH DISTURB LESS THAN ONE ACRE OF SOIL AND ARE NOT PART OF A LARGER COMMON PLAN OF DEVELOPMENT WHICH IN TOTAL DISTURBS ONE ACRE OR MORE, SHALL MANAGE STORM WATER DRAINAGE DURING CONSTRUCTION IN ACCORDANCE WITH THE CALIFORNIA GREEN BUILDING STANDARDS CODE.
CALL BEFORE YOU DIG! CONTACT UNDERGROUND SERVICE ALERT (USA) AT 1-800-227-2600 AT LEAST 2 WORKING DAYS BEFORE EXCAVATING.
FINISHED GROUND SURFACES SHALL BE GRADED TO DRAIN THE FINISHED SITE PROPERLY. FINISHED GROUND SLOPE WITHIN 5 FEET OF THE BUILDING OR STRUCTURE SHALL SLOPE AWAY AT 5%. ALL EXTERIOR HARD SURFACES (INCLUDING TERRACES) SHALL BE INSTALLED WITH A 1% MINIMUM SLOPE AND SHALL DRAIN AWAY FROM THE BUILDING. DRAINAGE GABLES SHALL HAVE A MINIMUM SLOPE OF 1% MAX ALLOWABLE GRADE SLOPE IS 3 HORIZONTAL FEET TO 1 VERTICAL (33%).
LOT GRADING SHALL CONFORM AT THE PROPERTY LINES AND SHALL NOT SLOPE TOWARD PROPERTY LINES IN A MANNER WHICH WOULD CAUSE STORMWATER TO FLOW ONTO NEIGHBORING PROPERTY. HISTORIC DRAINAGE PATTERNS SHALL NOT BE ALTERED IN A MANNER TO CAUSE DRAINAGE PROBLEMS TO NEIGHBORING PROPERTY.
NEW RAINWATER DOWNSPOUTS SHALL BE DISCONNECTED AND DIRECT RUNOFF TO A LANDSCAPED AREA. DOWNSPOUTS MAY BE CONNECTED TO A POP UP DRAINAGE EMITTER IN THE LANDSCAPED AREA OR MAY DRAIN TO SPLASH BLOCKS OR COBBLESTONES THAT DIRECT WATER AWAY FROM THE BUILDING.
CONTRACTOR TO FIELD VERIFY EXISTING DRAINAGE. IF EXISTING DRAINAGE SYSTEM IS DAMAGED DURING EXCAVATION, CONTRACTOR SHALL REPAIR AND/OR REROUTE DRAINAGE SYSTEM AND CONNECT TO EXISTING DRAINAGE FACILITY AS NECESSARY.
EXISTING IMPROVEMENTS THAT ARE DAMAGED BY THE PROJECT CONSTRUCTION SHALL BE REPAIRED OR REPLACED.
WATER METER, WATER LINE PIPE AND GAS LINE PIPE SIZING CALCULATIONS ALONG WITH ONE-LINE ISOMETRIC DRAWINGS MAY BE REQUIRED BY THE FIELD INSPECTOR AND WILL BE PROVIDED BY THE CONTRACTOR. ALL PLAN REVIEW FEES WILL BE PAID AS REQUIRED BY PERMITTEE.
PLUMBING DRAIN WASTE AND VENT/OR MECHANICAL DUCTING AND/OR ELECTRICAL WIRE DIAGRAMS OR DRAWINGS MAY BE REQUIRED BY THE FIELD INSPECTOR AND WILL BE PROVIDED BY THE CONTRACTOR UPON REQUEST. ALL PLAN REVIEW FEES WILL BE PAID AS REQUESTED BY THE PERMITTEE.
ELECTRICAL LOAD CALCULATIONS SHALL BE PROVIDED BY THE CONTRACTOR UPON THE REQUEST OF THE FIELD BUILDING INSPECTOR. ALL PLAN REVIEW FEES WILL BE PAID AS REQUIRED BY THE PERMITTEE.

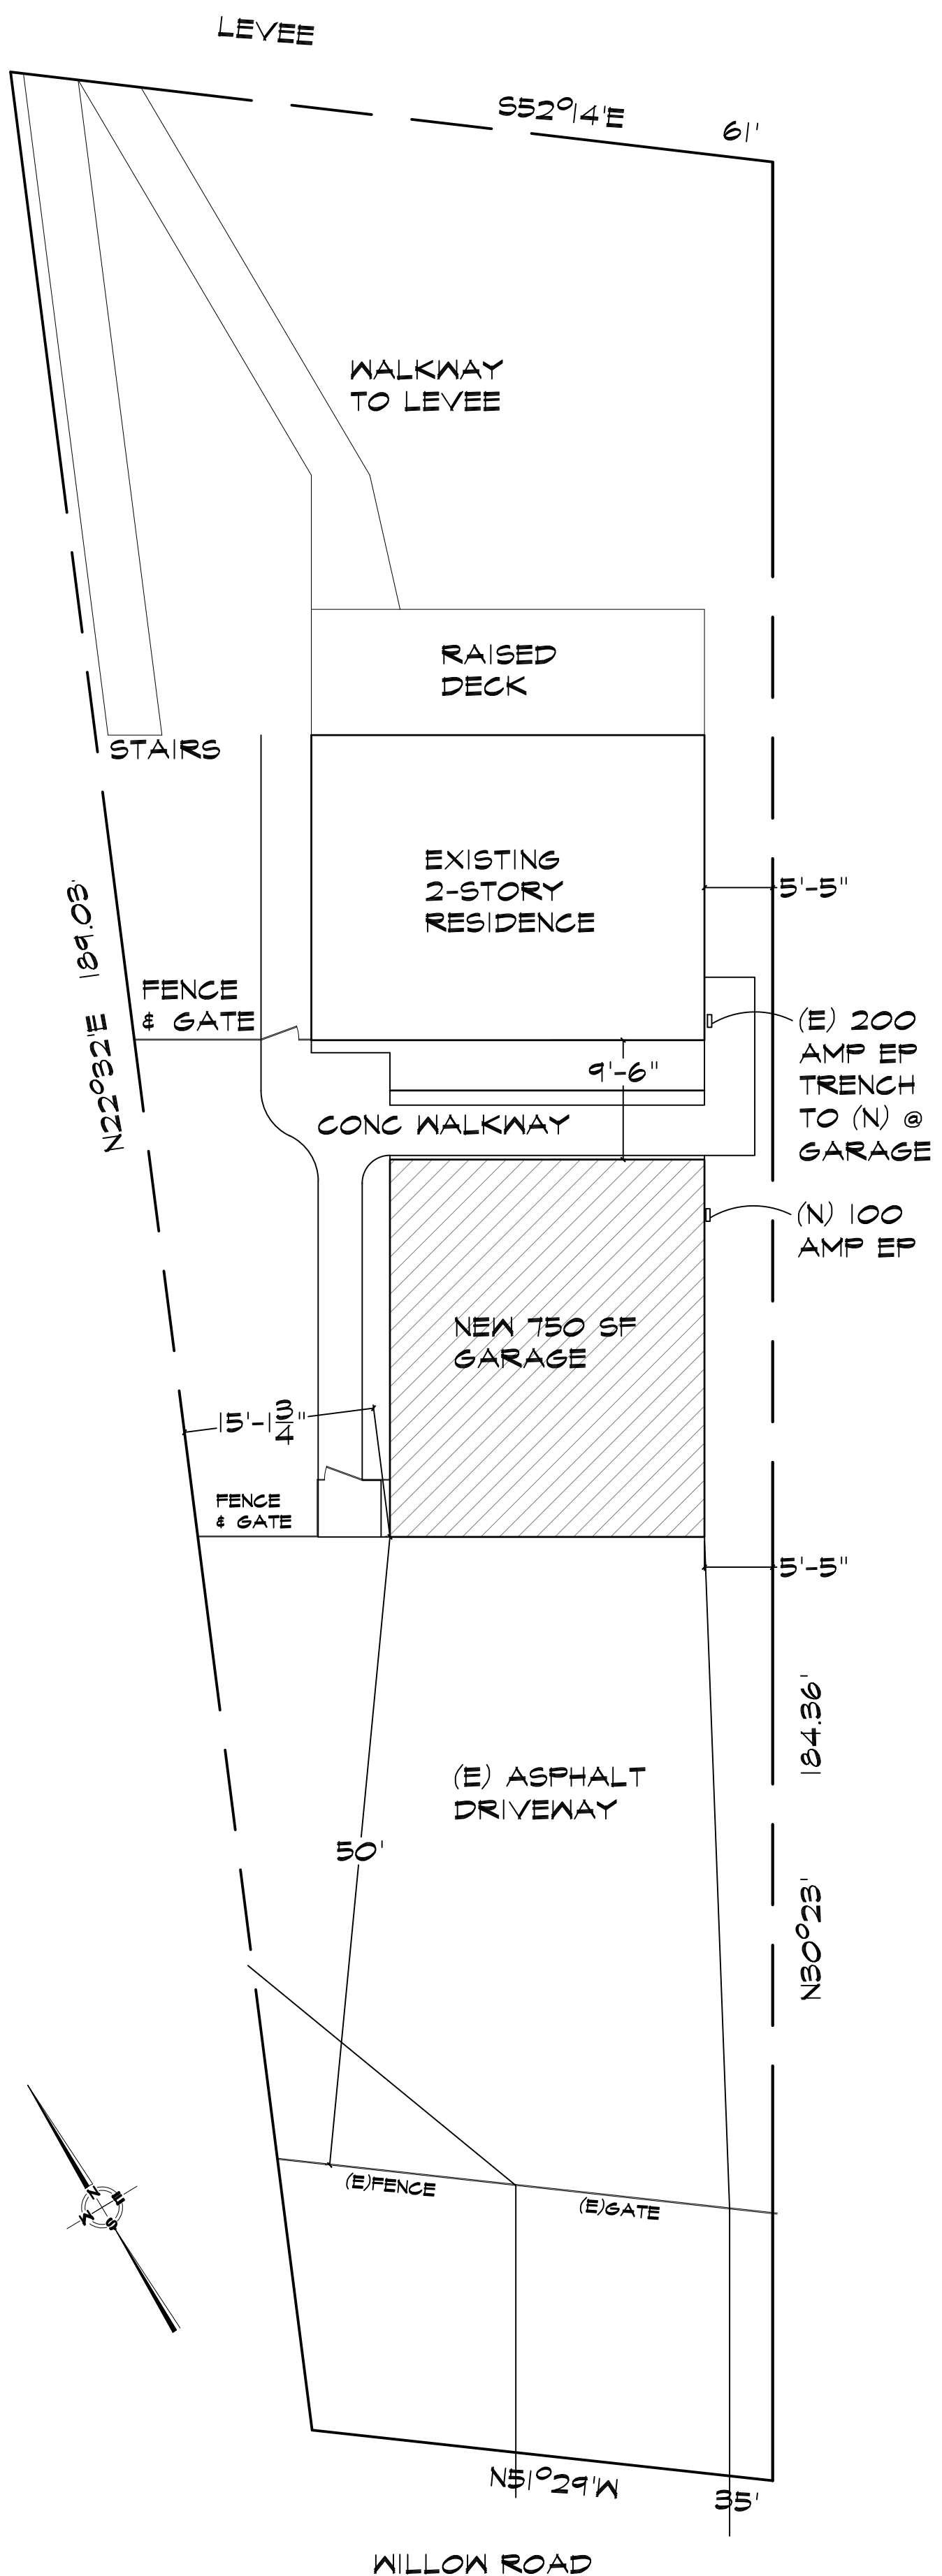

SITE PLAN
1/8" = 1'-0"

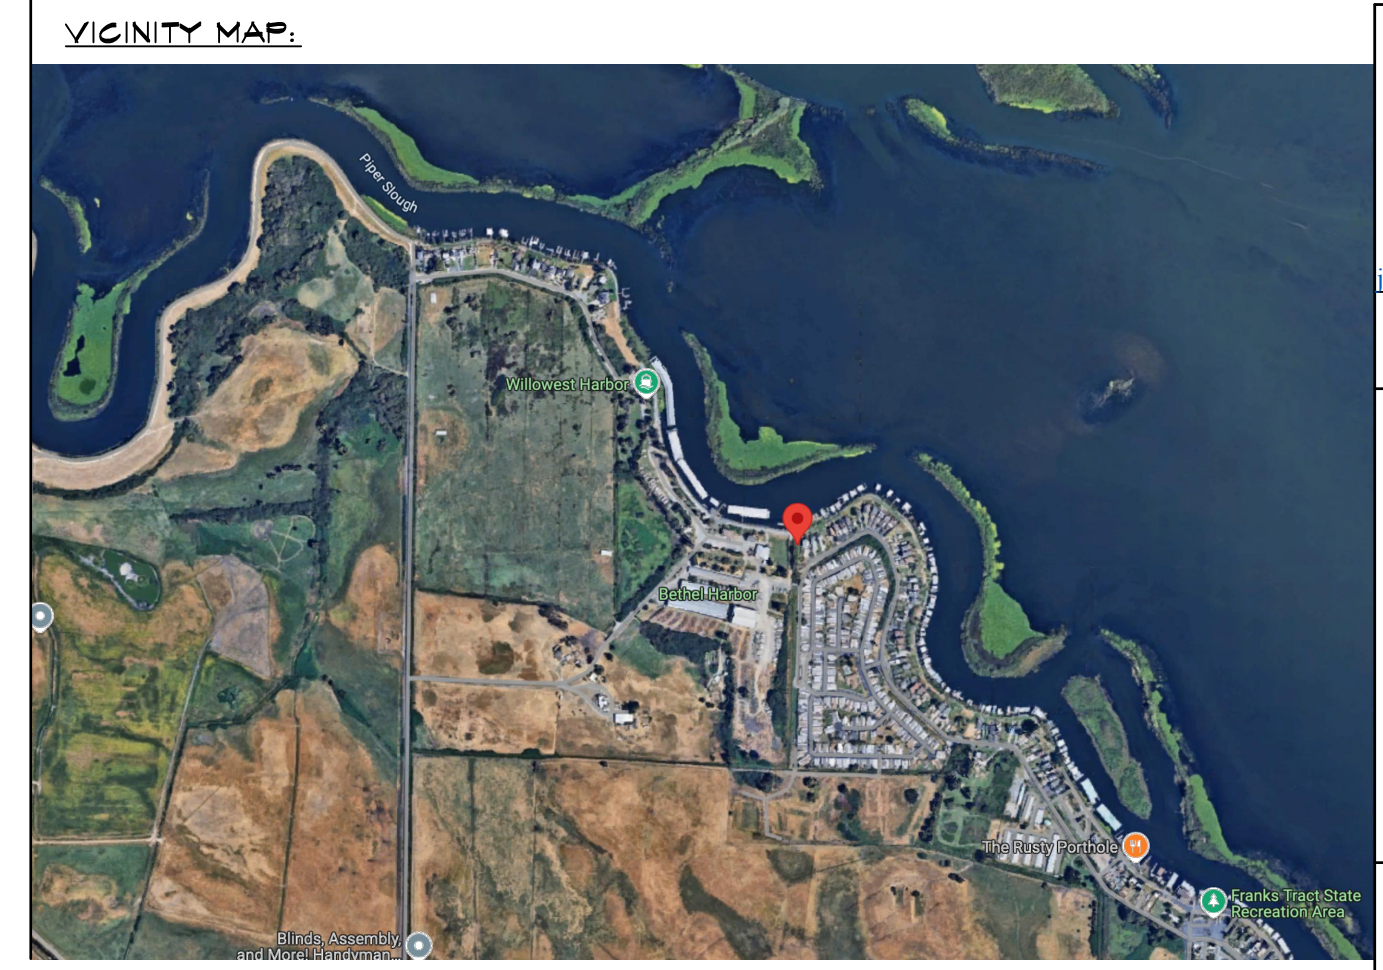

RECEIVED on 12/19/2024 **CDVR24-01060**
By Contra Costa County
Department of Conservation and Development

jb drafting & design
P.O. Box 2735
Dublin, CA 94568
925-998-3898
jenbrown@jbdraftingdesign.com

SIGNATURE: *Jennifer D. Brown*

THE DRAWINGS AND SPECIFICATIONS APPEARING HEREIN CONSTITUTE THE ORIGINAL WORK OF JB DRAFTING & DESIGN, LLC AND SHALL BE CONSIDERED CONFIDENTIAL AND PROPRIETARY. NO REPRODUCTION OR REPRODUCTION OF ANY PORTION OF THESE DOCUMENTS WITHOUT WRITTEN AUTHORIZATION IS STRICTLY PROHIBITED. THE CONTRACT DOCUMENTS WERE PREPARED FOR USE ON THIS SPECIFIC SITE IN CONFORMANCE WITH ITS ISSUE DATE AND ARE NOT SUITABLE FOR USE ON A DIFFERENT SITE OR AT A LATER DATE. THE REPRODUCTION OF THE CONTRACT DOCUMENTS FOR REUSE ON ANOTHER PROJECT IS NOT AUTHORIZED.

REVISIONS:

- △ N/A
- △ N/A
- △ N/A
- △ N/A
- △ N/A
- △ N/A

SHEET TITLE: GENERAL NOTES & SITE PLAN

JOB #241156

SCALE: AS NOTED

DRAWN BY: JDB

DATE: NOV 2024

SHEET NUMBER: **A1**

GEORGE & CLAUDIA NAVARRO
3565 WILLOW ROAD
BETHEL ISLAND, CA 94511

SIGNATURE
J. Brown

REVISIONS:

△	N/A
△	N/A
△	N/A
△	N/A
△	N/A
△	N/A
△	N/A

SHEET TITLE:
GARAGE FOUNDATION & ELECTRICAL PLAN

JOB #241156
SCALE: 1/4" = 1'-0"
DRAWN BY: JDB
DATE: NOV 2024


SHEET NUMBER:
A2

ELECTRICAL NOTES:


- ALL LIGHTING SHALL BE HIGH EFFICACY.
- ALL LIGHTING FIXTURES SHALL BE CONTROLLED BY EITHER A DIMMER SWITCH OR BY A VACANCY SENSOR SWITCH THAT REQUIRES A MANUAL ON ACTIVATION AND AUTOMATICALLY TURNS OFF WITHIN 30 MINS AFTER THE ROOM IS VACATED. EXCEPT THAT BATHROOMS, LAUNDRY ROOM, GARAGES AND UTILITY ROOMS SHALL HAVE ONE LIGHT FIXTURE CONTROLLED BY A VACANCY SENSOR. ALL OTHER LIGHTING IN OTHER ROOMS SHALL BE CONTROLLED BY A VACANCY SENSOR OR A DIMMER SWITCH.
- ALL LIGHT FIXTURES SHALL CONTAIN BULBS THAT ARE LABELED AS JAS-2016. SCREW BASE BULBS ARE PERMITTED, EXCEPT IN RECESSED LIGHTING FIXTURES. EXTERIOR LIGHTING AFFIXED TO THE RESIDENCE SHALL BE CONTROLLED BY A MANUAL ON/OFF SWITCH, WATER/WEATHER PROOF & SHALL BE HIGH EFFICACY IN ADDITION TO INCLUDE ONE OF THE FOLLOWING: A. PHOTOCELL & MOTION SENSOR B. PHOTOCONTROL & AUTOMATIC TIME SWITCH CONTROL C. ASTRONOMICAL TIME CLOCK CONTROL D. ENERGY MANAGEMENT CONTROL SYSTEM
- LUMINARIES THAT ARE TO BE RECESSED INTO INSULATED CEILING SHALL BE IC-RATED, AIR-TIGHT, SEALED/CAULKED BETWEEN THE FIXTURE HOUSING AND CEILING, SHALL NOT CONTAIN A SCREW BASE SOCKET AND CONTAIN BULBS MARKED WITH JAS-2016-E EFFICIENCY LABEL. RECESSED LUMINARIES SHALL BE CONTROLLED BY DIMMERS OR VACANCY SENSOR. RECESSED LUMINARIES SHALL COMPLY WITH THE REFERENCE JOINT APPENDIX JAS AND SHALL NOT CONTAIN SCREW BASE SOCKETS IN ADDITION TO BEING CONTROLLED BY A DIMMER SWITCH OR VACANCY SENSOR.
- ALL 125 VOLT 15 & 20 AMP RECEPTACLES SHALL BE TAMPER-RESISTANT RECEPTACLES.
- ELECTRICAL OUTLETS IN KITCHEN, LAUNDRY & BATH SHALL BE 15 AMP, 120V W/ DUAL FUNCTION GFCI & AFCI.
- ALL OUTLETS WITHIN 6' FEET OF A SINK SHALL HAVE GFCI PROTECTION.
- A 120-VOLT RECEPTACLE OUTLET REQUIRED AT WASHING MACHINE IN LAUNDRY AREA.
- A DEDICATED 20-AMP OUTLET IS REQUIRED TO SERVE THE REQUIRED BATHROOM OUTLETS. THIS CIRCUIT CANNOT SUPPLY ANY OTHER RECEPTACLES, LIGHTS, FANS, ETC. (EXCEPTION--WHERE THE CIRCUIT SUPPLIES A SINGLE BATHROOM, OUTLETS FOR OTHER EQUIPMENT WITHIN THE SAME BATHROOM SHALL BE PERMITTED TO BE SUPPLIED.)
- CARBON MONOXIDE ALARMS SHALL RECEIVE THEIR PRIMARY POWER FROM THE BUILDING WIRING AND SHALL BE EQUIPPED WITH BATTERY BACK-UP.
- AT LEAST 2 OR MORE 20 AMP SMALL-APPLIANCE BRANCH CIRCUITS SHALL BE PROVIDED AT THE KITCHEN.
- ALL BRANCH CIRCUITS SUPPLYING OUTLETS OR DEVICES INSTALLED IN BEDROOM AND SIMILAR ROOMS/SPACES SHALL HAVE A LISTED COMBINATION TYPE ARC-FAULT CIRCUIT INTERRUPTER.
- BATHROOM EXHAUST FAN SHALL BE RATED FOR MIN 50 CFM AND KITCHEN EXHAUST FAN TO BE RATED FOR MIN 100 CFM.
- THE FOLLOWING COMPONENTS SHALL BE PROVIDED FOR THE WATER HEATING SYSTEM:
 - A DEDICATED 125-VOLT 20-AMP ELECTRICAL RECEPTACLE THAT IS CONNECTED TO THE ELECTRIC PANEL WITH A 120/240-VOLT 3 CONDUCTOR, 10 AWG COPPER BRANCH CIRCUIT WITHIN 3' FROM THE WATER HEATER ACCESSIBLE TO THE WATER HEATER WITH NO OBSTRUCTIONS. IN ADDITION ALL OF THE FOLLOWING:
 - BOTH ENDS OF THE UNUSED CONDUCTOR SHALL BE LABELED WITH THE WORD "SPARE" AND BE ELECTRICALLY ISOLATED; AND
 - A RESERVED SINGLE POLE CIRCUIT BREAKER SPACE IN THE ELECTRICAL PANEL ADJACENT TO THE CIRCUIT BREAKER FOR THE BRANCH CIRCUIT IN A ABOVE AND LABELED WITH THE WORDS "FUTURE 240V USE"
 - A CATEGORY III OR IV VENT, OR A TYPE B VENT WITH STRAIGHT PIPE BETWEEN THE OUTSIDE TERMINATION AND THE SPACE WHERE THE WATER HEATER IS INSTALLED.
 - A CONDENSATE DRAIN THAT IS NO MORE THAN 2" HIGHER THAN THE BASE OF THE INSTALLED WATER HEATER, AND ALLOWS NATURAL DRAINING WITHOUT PUMP ASSISTANCE
 - A GAS SUPPLY LINE WITH A CAPACITY OF AT LEAST 200,000 BTU/HR.

ELECTRICAL KEY:


- ⊖/⊖ 110V DUPLEX/ 220V OUTLET
- ⊘/⊘ SWITCH/3-WAY SWITCH
- ⊙ RECESSED CAN LT.
- ⊖ WALL-MOUNT LT.
- ⊙ CEILING MOUNT LT.
- ⊖ LED ROPE LTG.
- ⊙ CARBON MONOXIDE & SMOKE DETECTOR COMBO; VERIFY (E)
- ⊙ HARD-WIRED, INTERCONNECTED SMOKE DETECTOR; VERIFY (E)
- ⊖ CEILING MOUNT PEDANT LT.
- ⊖ GAS STUB
- ⊖ CEILING VENT/FAN
- ⊙ CEILING-MT. FAN W/ LT.

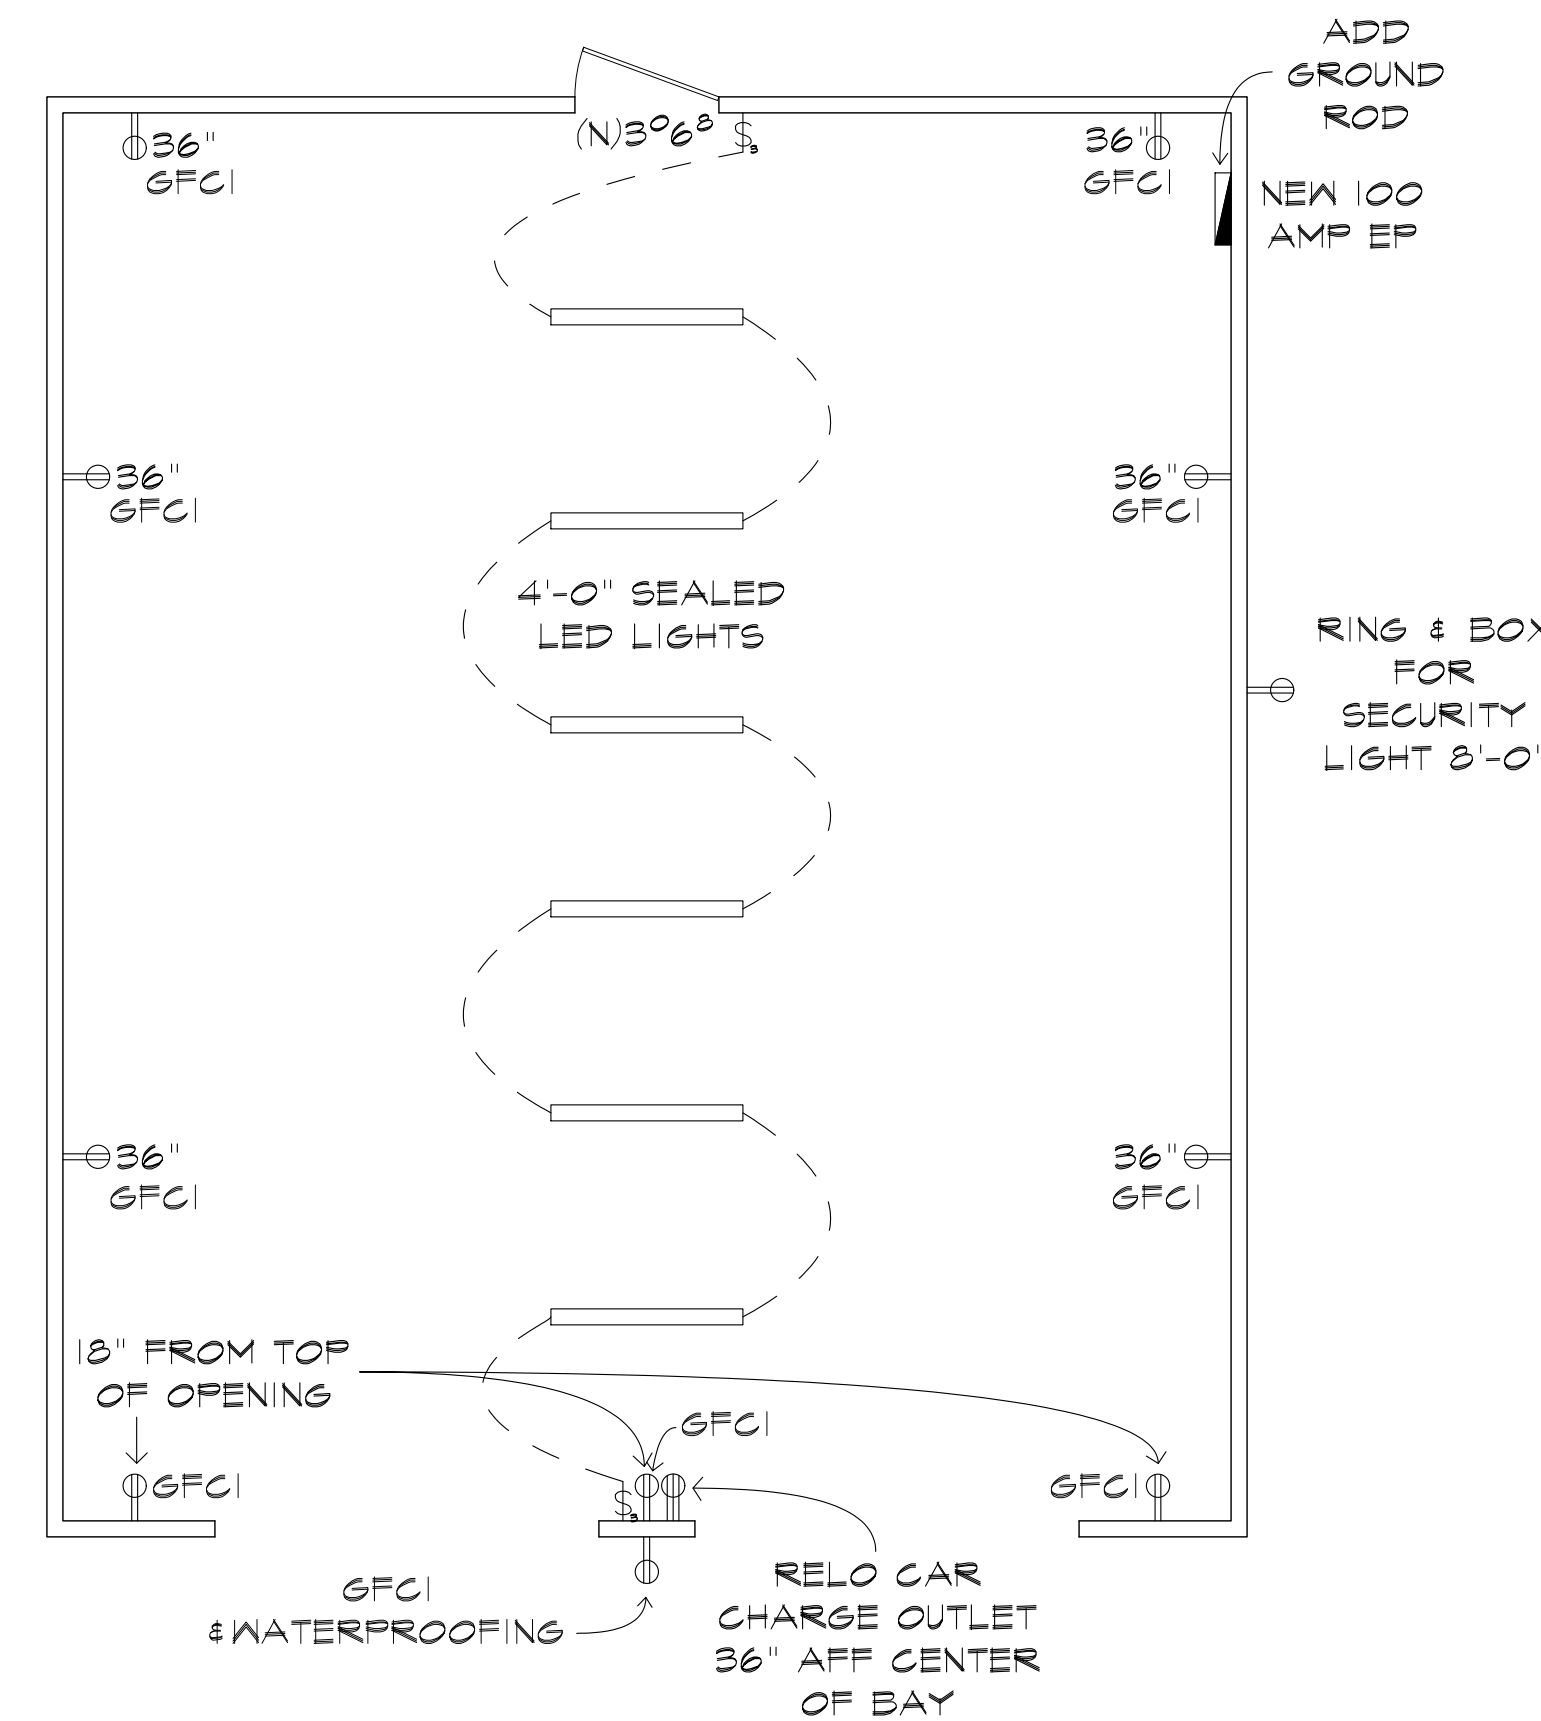

PROPOSED ELECTRICAL PLAN

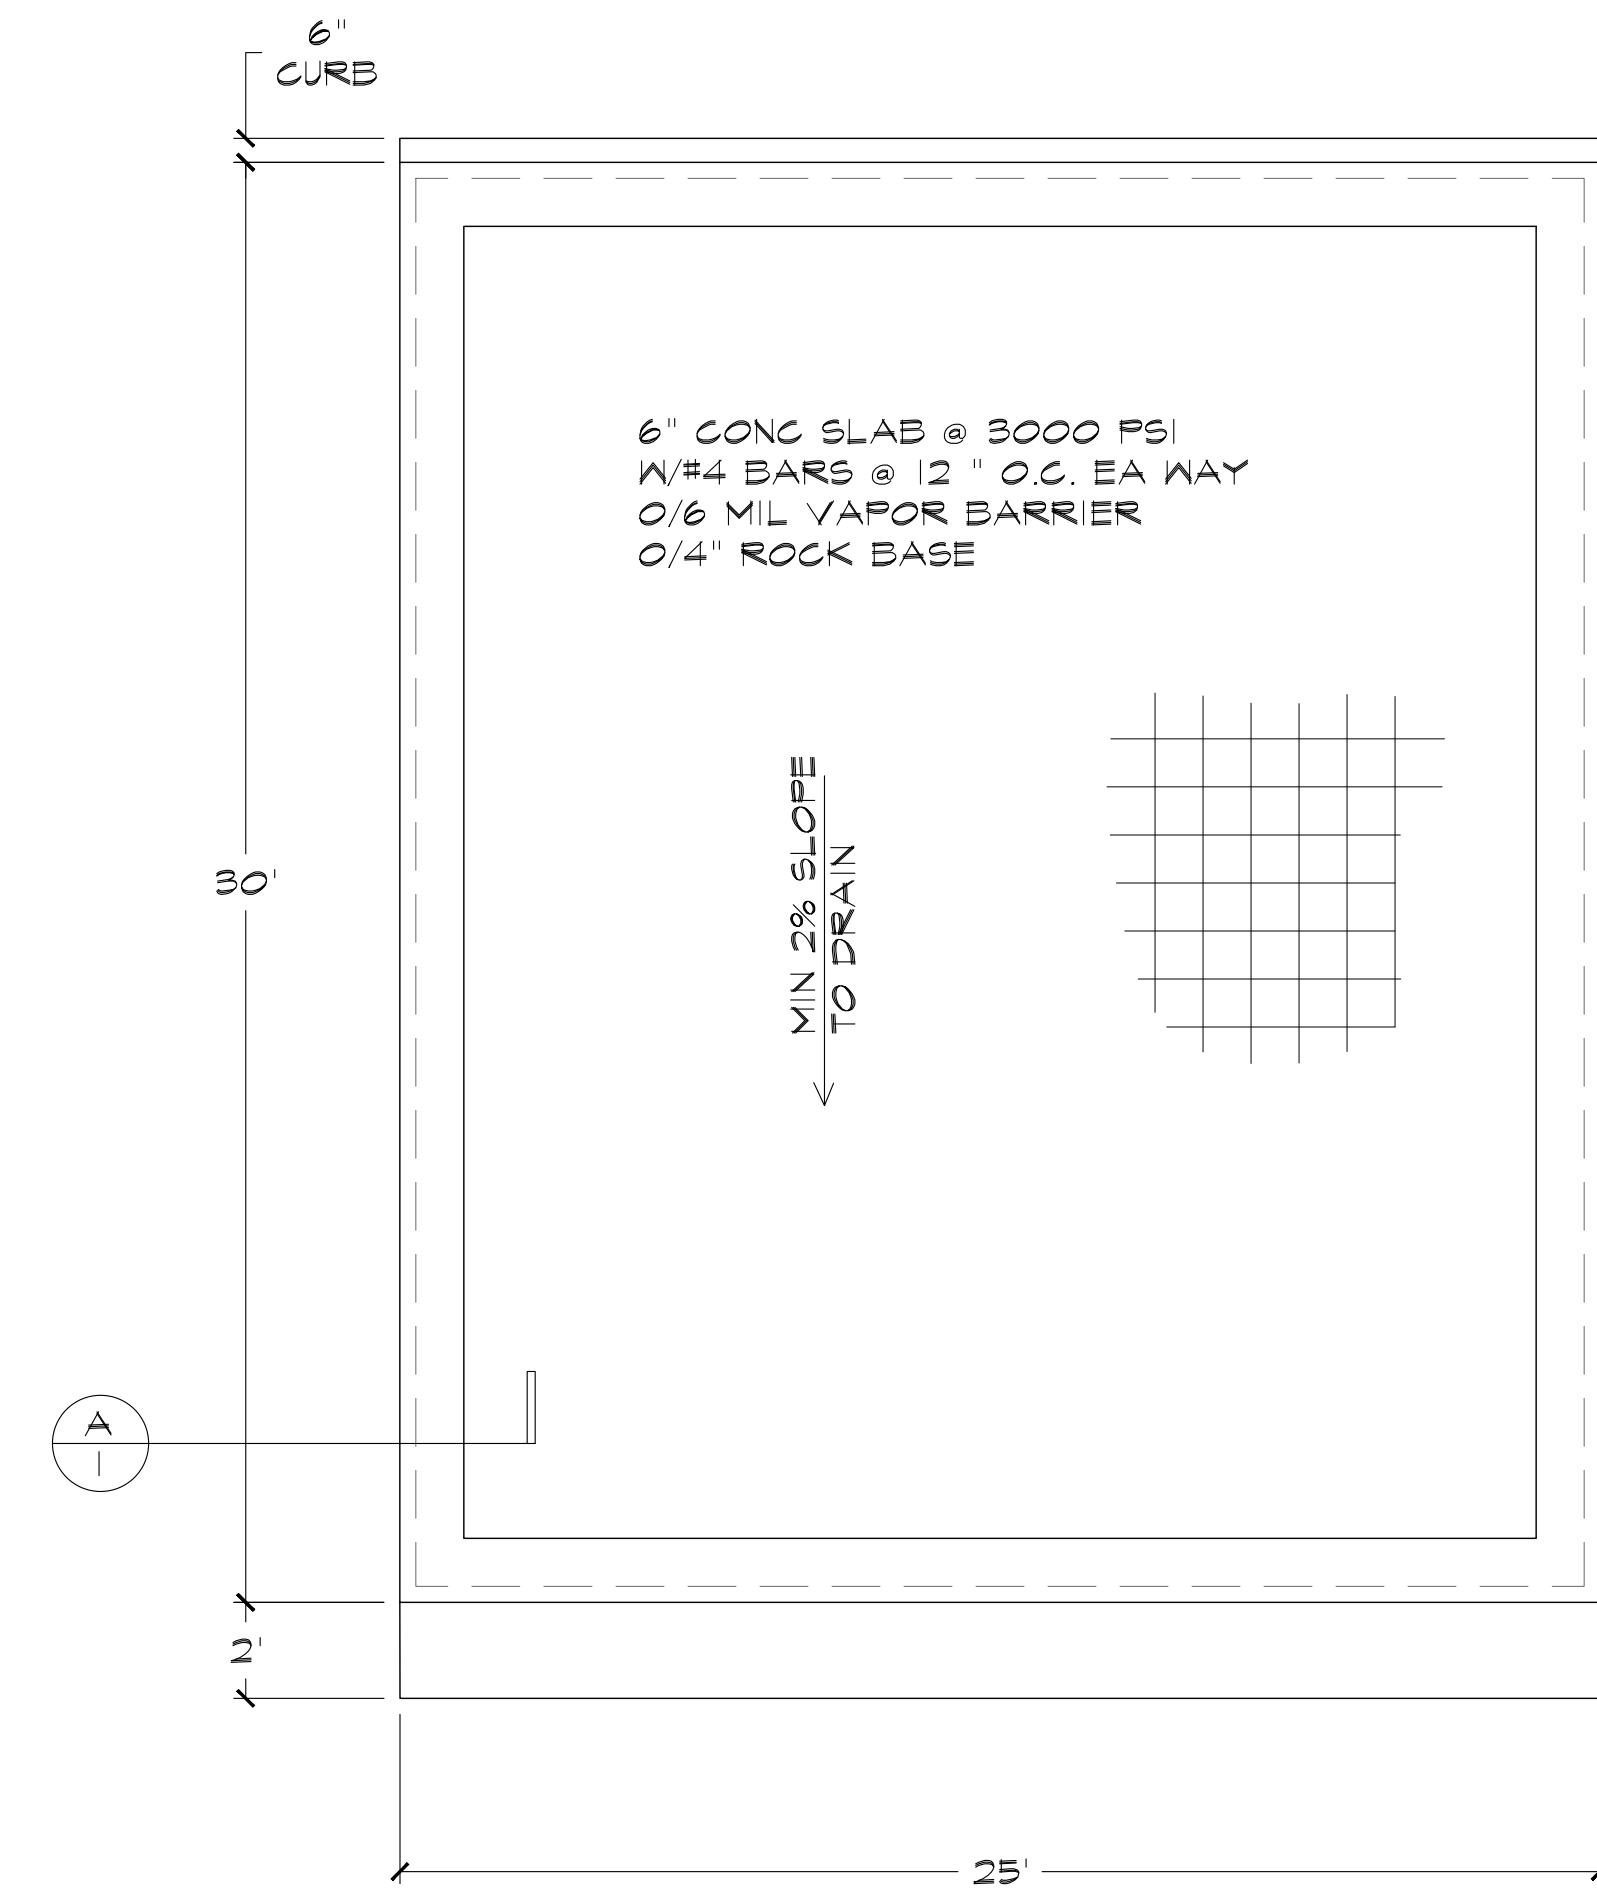

PROPOSED GARAGE FOUNDATION

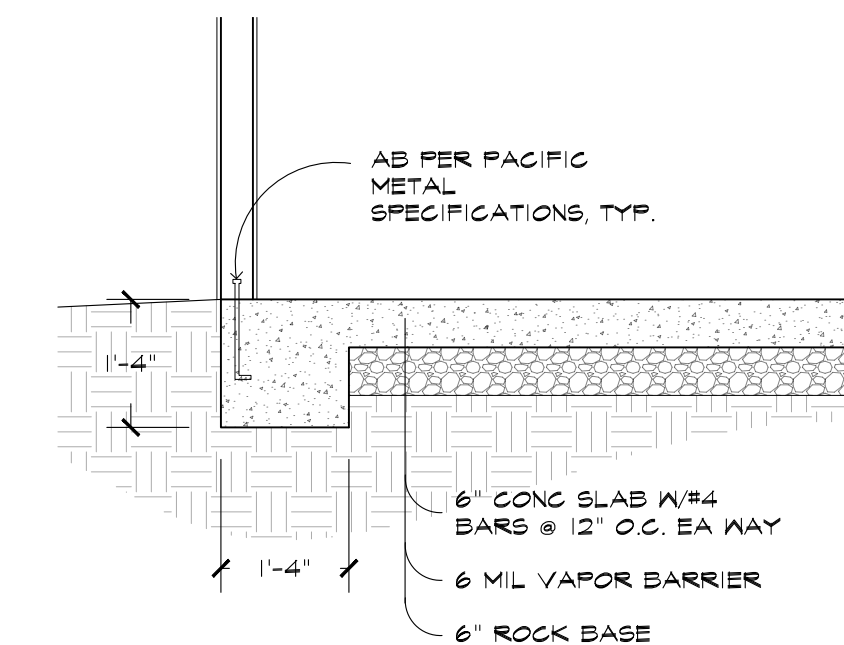

DETAIL A-1

ELEVATIONS

SHEET TITLE: METAL BUILDING MANUFACTURER

PROJECT TITLE: GEORGE NAVARRO

LOCATION: 3565 WILLOW RD
BETHEL ISLAND, CA 94511

3565 WILLOW RD
BETHEL ISLAND, CA 94511

270 Old Highway 99
Maxwell, CA 95955
1-877-604-2777



WARNING: Unauthorized copy or use of the seal below is considered forgery subject to legal action to the fullest extent of the law and/or fines.

GEORGE NAVARRO
3565 WILLOW RD
BETHEL ISLAND, CA 94511

REGISTERED PROFESSIONAL ENGINEER
CIVIL
RAFAEL D. SALGADO
C95761
STATE OF CALIFORNIA

GEORGE NAVARRO
3565 WILLOW RD
BETHEL ISLAND, CA 94511

EXPIRES: 03/31/2026
SIGNED: NOV 18 2024

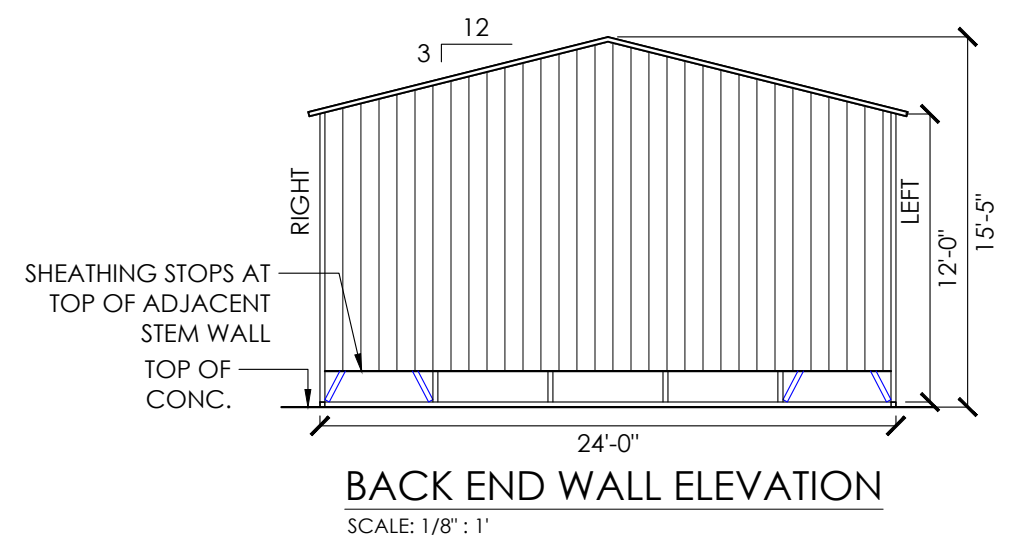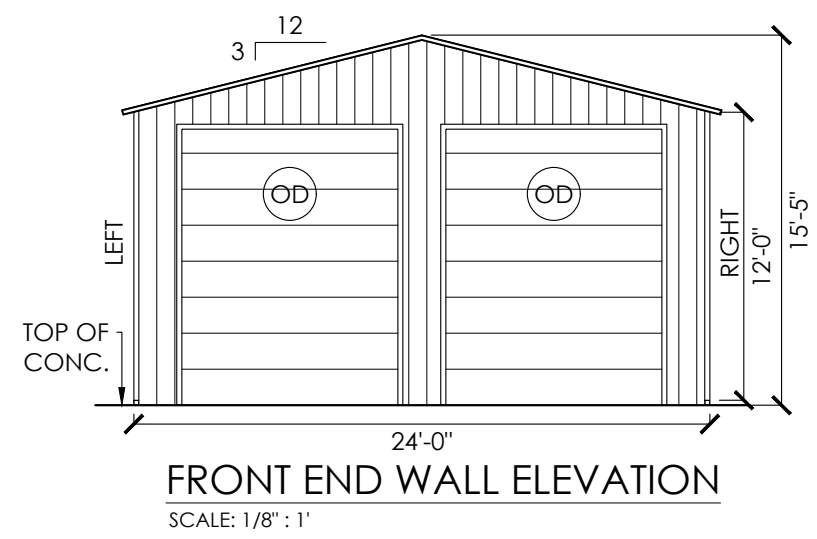

DESIGN NOTES



1. THE INTENTION OF ELEVATIONS PROVIDED ON THIS SHEET IS TO INDICATE STRUCTURAL COMPONENTS, DIMENSIONS, AND BUILDING ORIENTATION ONLY.
2. ARCHITECTURAL DESIGN REQUIREMENTS ARE NOT COVERED IN THIS PLAN SET. THESE DESIGN REQUIREMENTS SHALL BE ADDRESSED IN A SEPARATE ARCHITECTURAL SET BY RESPONSIBLE LICENSED PROFESSIONALS IN CHARGE, AS NEEDED.
3. ALL EXT **ROOF** SHEATHING SHALL BE:
CLASS A RATED 26GA. **1 1/4" PBR PANEL** - PER UES ER 0550 OR EQ.
(REF. SHT 5 FOR PROFILE AND FASTENER SCHD.)
4. ALL EXT **WALL** SHEATHING SHALL BE:
CLASS A RATED 26GA. **1 1/4" STRATA RIB** - PER UES ER 0550 OR EQ.
(REF. SHT 5 FOR PROFILE AND FASTENER SCHD.)
5. **SHEATHING CONNECTIONS SHALL BE #12-14 X 3/4" SDS** (PER UES-ER 0550 REQ.) W/ BONDED NEOPRENE WASHER PER ESR 2196.


LEGEND

- (WN) WINDOWS (REF WINDOW MFG)
- (OD) OVER HEAD / ROLL-UP DOOR (REF DOOR MFG)

NOTE 1: ANY DOOR OR WINDOW DESIGN & CONNECTION / ATTACHMENT INFORMATION, IS NOT COVERED IN THIS PLAN SET AND SHALL BE ADDRESSED BY OTHERS.

NOTE 2: LOC OF WINDOWS CAN BE DETERMINED ON SITE AS LONG AS THEY FALL BETWEEN BAYS (BETWEEN FULL FRAMES).

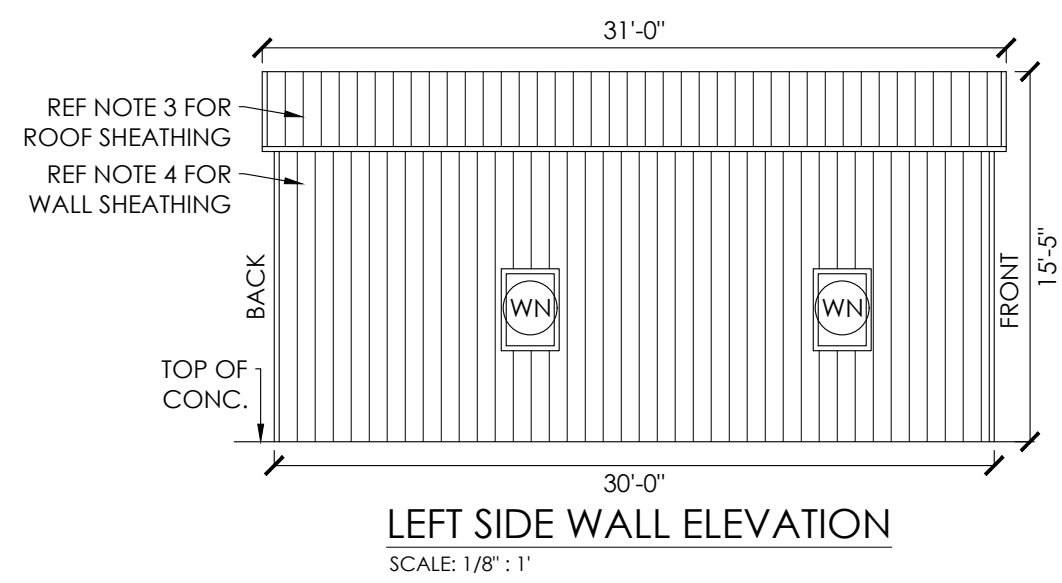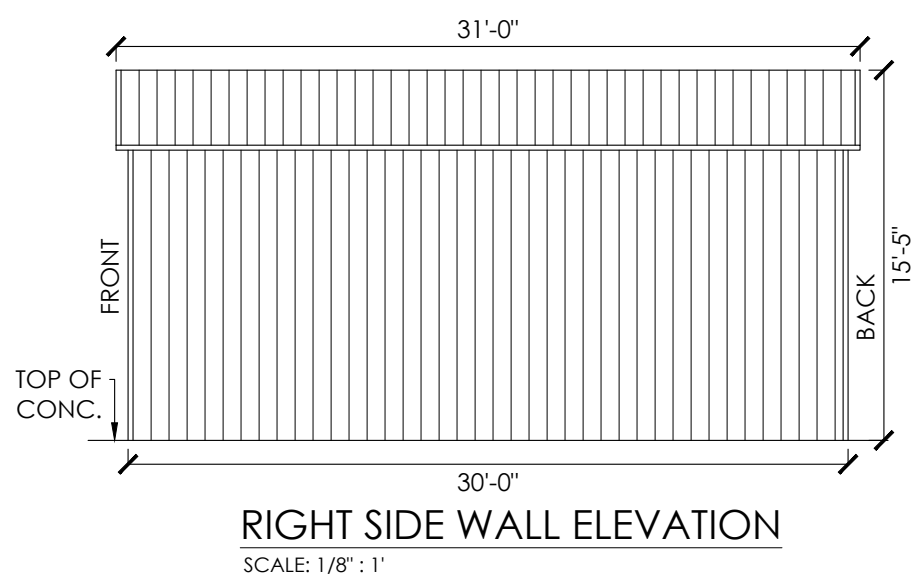

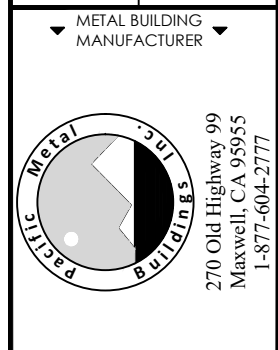

Corner Posts Max. Values							
Load Case	Fx	Fy (BRG)	Fy (UPLIFT)	Fz	Mx	My	Mz
(UNITS)	(KIP)	(KIP)	(KIP)	(KIP)	(KIP-IN)	(KIP-IN)	(KIP-IN)
DEAD	0.090	0.726	0.646	0.104	0.000	0.000	0.000
LIVE	0.306	2.690	2.371	0.402	0.000	0.000	0.000
Wind X (POS.)	0.711	1.956	-3.504	0.505	0.000	0.000	0.000
Wind X (NEG.)	0.699	2.218	-3.223	0.411	0.000	0.000	0.000
Wind Z (POS.)	0.248	0.692	-2.089	0.327	0.000	0.000	0.000
Wind Z (NEG.)	0.239	0.610	-1.822	0.233	0.000	0.000	0.000
Seismic X (POS.)	0.101	0.383	-0.383	0.035	0.000	0.000	0.000
Seismic X (NEG.)	0.101	0.383	-0.383	0.035	0.000	0.000	0.000
Seismic Z (POS.)	0.004	0.123	-0.129	0.042	0.000	0.000	0.000
Seismic Z (NEG.)	0.004	0.129	-0.123	0.042	0.000	0.000	0.000

Outer Side Wall Posts Max. Values (Non-corner)							
Load Case	Fx	Fy (BRG)	Fy (UPLIFT)	Fz	Mx	My	Mz
(UNITS)	(KIP)	(KIP)	(KIP)	(KIP)	(KIP-IN)	(KIP-IN)	(KIP-IN)
DEAD	0.009	0.223	0.047	0.020	0.000	0.000	0.000
LIVE	0.047	0.330	-0.308	0.042	0.000	0.000	0.000
Wind X (POS.)	0.352	0.389	-0.638	0.698	0.000	0.000	0.000
Wind X (NEG.)	0.453	0.590	-0.394	0.638	0.000	0.000	0.000
Wind Z (POS.)	0.388	-0.402	-0.585	0.483	0.000	0.000	0.000
Wind Z (NEG.)	0.311	-0.173	-0.342	0.586	0.000	0.000	0.000
Seismic X (POS.)	0.000	0.089	-0.089	0.076	0.000	0.000	0.000
Seismic X (NEG.)	0.000	0.089	-0.089	0.076	0.000	0.000	0.000
Seismic Z (POS.)	0.000	0.026	-0.027	0.058	0.000	0.000	0.000
Seismic Z (NEG.)	0.000	0.027	-0.026	0.058	0.000	0.000	0.000

End Wall Posts Max. Values (Non-corner)							
Load Case	Fx	Fy (BRG)	Fy (UPLIFT)	Fz	Mx	My	Mz
(UNITS)	(KIP)	(KIP)	(KIP)	(KIP)	(KIP-IN)	(KIP-IN)	(KIP-IN)
DEAD	0.048	0.388	0.000	0.010	0.000	0.000	0.000
LIVE	0.146	1.190	0.000	0.051	0.000	0.000	0.000
Wind X (POS.)	0.950	2.260	-3.104	0.808	0.000	0.000	0.000
Wind X (NEG.)	0.911	2.739	-2.607	0.574	0.000	0.000	0.000
Wind Z (POS.)	0.285	0.000	-0.766	0.417	0.000	0.000	0.000
Wind Z (NEG.)	0.167	0.066	-0.308	0.633	0.000	0.000	0.000
Seismic X (POS.)	0.108	0.330	-0.330	0.000	0.000	0.000	0.000
Seismic X (NEG.)	0.108	0.330	-0.330	0.000	0.000	0.000	0.000
Seismic Z (POS.)	0.020	0.063	-0.045	0.000	0.000	0.000	0.000
Seismic Z (NEG.)	0.020	0.045	-0.063	0.000	0.000	0.000	0.000


FOUNDATION REACTIONS

- REACTION NOTES:
- REACTIONS ARE PROVIDED FOR FOUNDATION ENGINEER.
 - POSITIVE Fy VALUE INDICATES BEARING.
 - NEGATIVE Fy VALUE INDICATES UPLIFT.
 - Fx AND Fz ARE ABSOLUTE VALUES.

- NOTE:
- THE ENGINEER'S CERTIFICATION IS LIMITED TO THE STRUCTURAL ENGINEERING FOR THE PREFABRICATED STRUCTURAL FRAMING AND POST INSTALLED CONCRETE ANCHORAGE ONLY.
 - STRUCTURAL BASE REACTIONS VALUES ARE PROVIDED HEREIN TO AID THE DESIGN AND / OR CHECK THE AS-BUILT ANCHORAGE & FOUNDATION BY OTHERS. FOUNDATION HAS NOT BEEN SPECIFIED IN THIS PLAN SET AND SHALL BE THE RESPONSIBILITY OF OTHERS.

AS-BUILT / EXISTING FOUNDATION NOTES:

- THE VALIDITY OF ENGINEER'S STAMP ON THIS SHEET DOES **NOT** COVER EITHER THE DESIGN OR REINFORCEMENT OF THE AS-BUILT FOUNDATION (AS FOUNDATION WAS POURED PRIOR TO ENGINEER OF RECORD'S INVOLVEMENT OR RECOMMENDATION). ALL AS-BUILT FOUNDATION DESIGN AND REINFORCEMENT SHALL BE RESPONSIBILITY OF ORIGINAL FOUNDATION DESIGNERS / OTHERS RESPONSIBLE.
- A MIN. SLAB SIZE OF 24'-8" X 30'-6" IS NECESSARY TO ALLOW THE MIN. OF 4" ANCHOR-TO-CONCRETE EDGE DISTANCE.
- CONCRETE ANCHORS SHALL BE LOCATED AS SHOWN ON THE ANCHORAGE PLAN WITH A MINIMUM OF (1) ANCHOR PER POST.
- ASSUMED CONCRETE STRENGTH FOR ANCHORAGE DESIGN TO BE A MIN OF 3000 PSI.

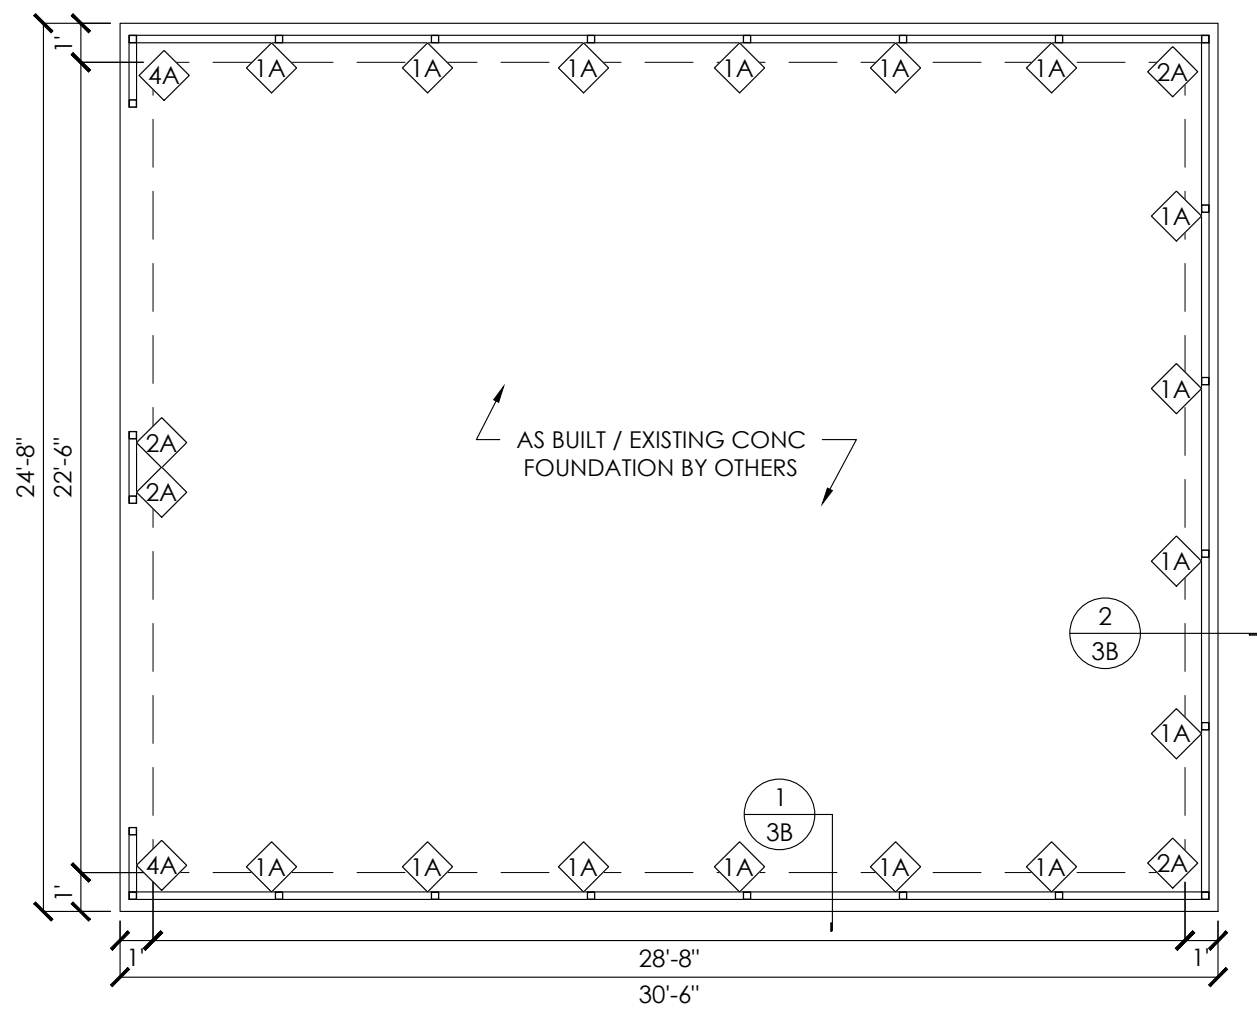

ANCHORAGE PLAN
SCALE: 3/16" : 1'

CONCRETE ANCHORAGE	
1A	(1) 1/2"Ø x 7" LG. STRONG-BOLT 2EXPANSION ANCHOR (PER ESR 3037)
2A	(2) 1/2"Ø x 7" LG. STRONG-BOLT 2EXPANSION ANCHOR (PER ESR 3037)
4A	(4) 1/2"Ø x 7" LG. STRONG-BOLT 2EXPANSION ANCHOR (PER ESR 3037)

WARNING: Unauthorized copy or use of the seal below is considered forgery subject to legal action to the fullest extent of the law and/or fines.

GEORGE NAVARRO
3565 WILLOW RD
BETHEL ISLAND, CA 94511

GEORGE NAVARRO
3565 WILLOW RD
BETHEL ISLAND, CA 94511


GEORGE NAVARRO
3565 WILLOW RD
BETHEL ISLAND, CA 94511

GEORGE NAVARRO
3565 WILLOW RD
BETHEL ISLAND, CA 94511


EXPIRES: 03/31/2026
SIGNED: NOV 18 2024



CONCRETE ANCHORAGE	
1A	(1) 1/2"Ø x 7" LG. STRONG-BOLT 2EXPANSION ANCHOR (PER ESR 3037)
2A	(2) 1/2"Ø x 7" LG. STRONG-BOLT 2EXPANSION ANCHOR (PER ESR 3037)
4A	(4) 1/2"Ø x 7" LG. STRONG-BOLT 2EXPANSION ANCHOR (PER ESR 3037)

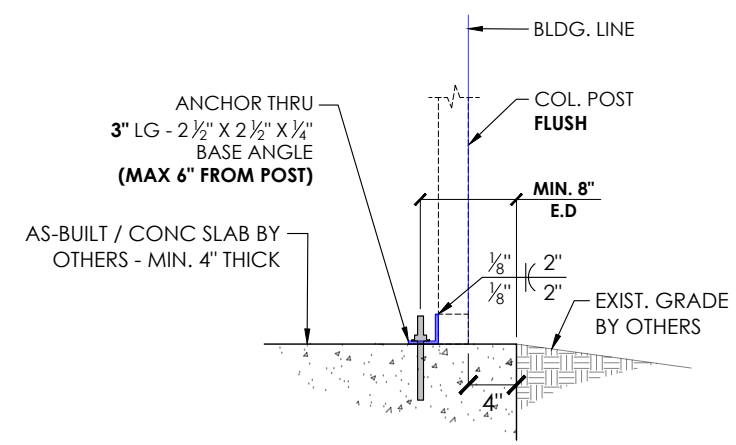

1 FOUNDATION DETAILS
 SCALE: 3/4" : 1'

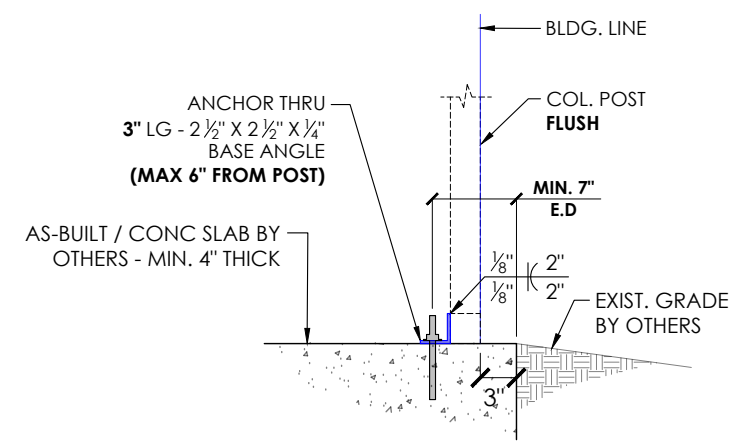


2 FOUNDATION DETAILS
 SCALE: 3/4" : 1'

ANCHOR NOTES:

- ANCHOR INSTALLATION REQUIREMENTS (REF ANCHORAGE DETAIL):
 - E.D.** - ANCHOR EDGE DISTANCE: MIN. 4" OR U.N.O.
 - H.** - ANCHOR HOLE DEPTH: MIN. 3.00"
 - D.** - CONCRETE EMBEDMENT DEPTH: MIN. 2.75"
 - SPACING BETWEEN (2) ANCHORS: MIN. 2.75" OR U.N.O.
- ANCHORS TO BE SPACED NO MORE THAN 6" FROM POSTS OR U.N.O.
- ANCHORS TO BE INSTALLED PER MANUFACTURER'S REQ. PER SPECIFIED ESR.

AS-BUILT NOTE:

- ANY AS-BUILT INFORMATION OR DETAILS HAVE BEEN PREPARED BASED ON INFORMATION PROVIDED BY OTHERS. THE ENGINEER HAS NOT INSPECTED THE ACCURACY AND/OR THE COMPLETENESS OF THIS INFORMATION AND SHALL NOT BE RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH MAY BE INCORPORATED HEREIN AS A RESULT.

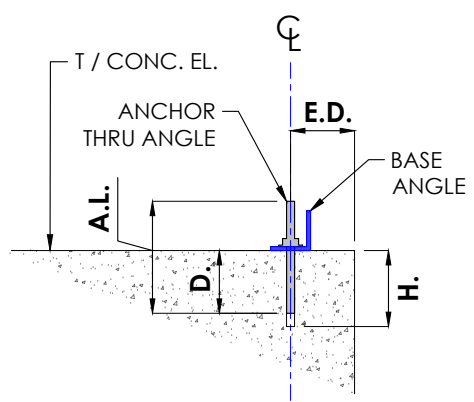


ANCHORAGE DETAIL
 SCALE: NTS

SHEET TITLE: **ANCHORAGE TO AS-BUILT & NOTES**

LOCATION: 3565 WILLOW RD
 BETHEL ISLAND, CA 94511

PROJECT TITLE: **GEORGE NAVARRO**

METAL BUILDING MANUFACTURER



WARNING: Unauthorized copy or use of the seal below is considered forgery subject to legal action to the fullest extent of the law and/or fines.

GEORGE NAVARRO
 3565 WILLOW RD
 BETHEL ISLAND, CA 94511

GEORGE NAVARRO
 3565 WILLOW RD
 BETHEL ISLAND, CA 94511

GEORGE NAVARRO
 3565 WILLOW RD
 BETHEL ISLAND, CA 94511

GEORGE NAVARRO
 3565 WILLOW RD
 BETHEL ISLAND, CA 94511


EXPIRES: 03/31/2026
SIGNED: NOV 18 2024

FRAME SECTION & DETAILS


LOCATION: 3565 WILLOW RD
BETHEL ISLAND, CA 94511

PROJECT TITLE: GEORGE NAVARRO


METAL BUILDING MANUFACTURER




270 Old Highway 99
Maxwell, CA 95955
1-877-604-2777

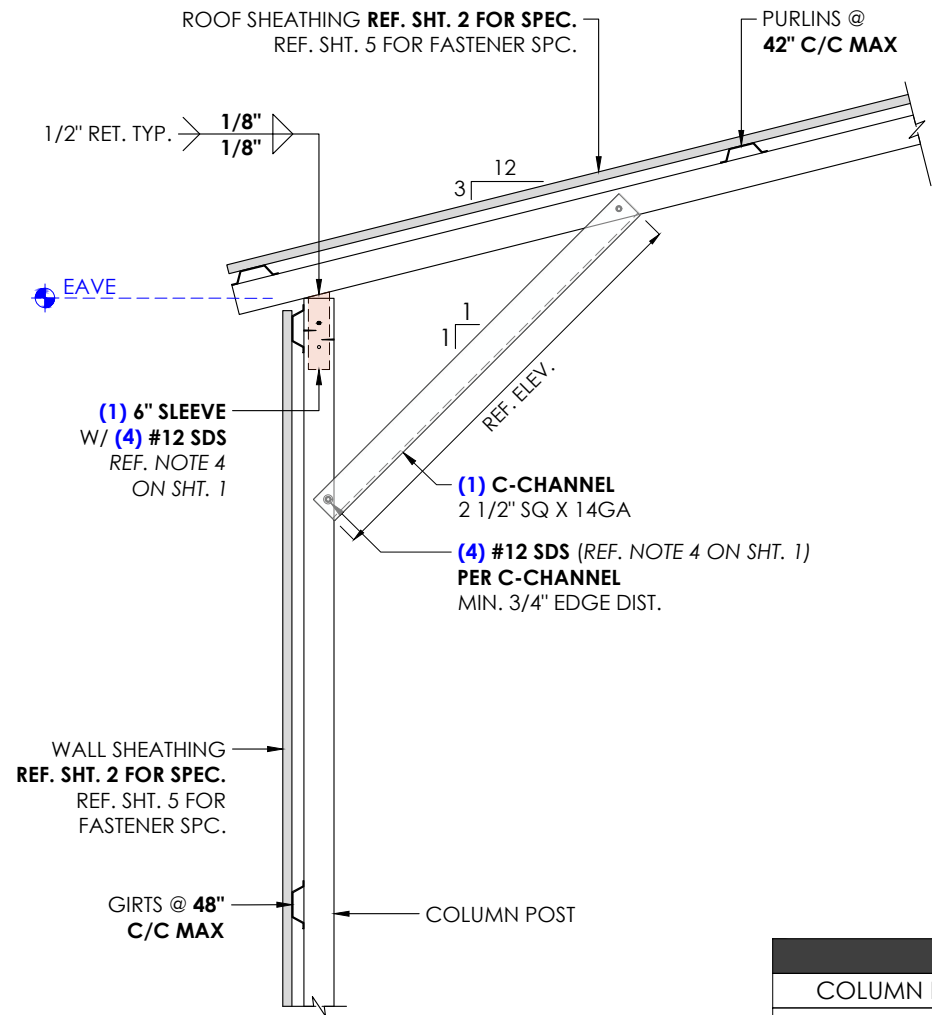

1 FRAME DETAIL
SCALE: 3/4" : 1'

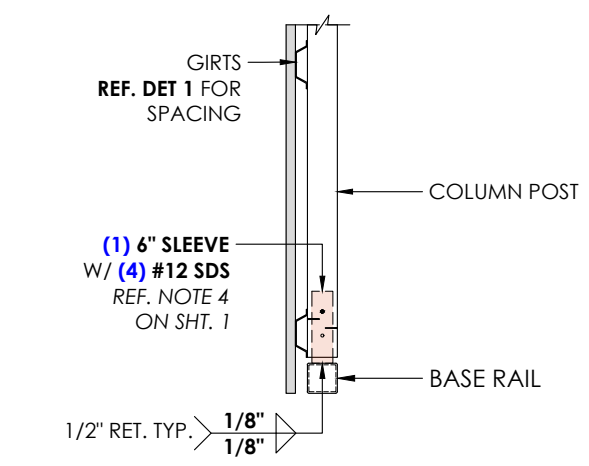

2 BASE DETAIL
SCALE: 3/4" : 1'

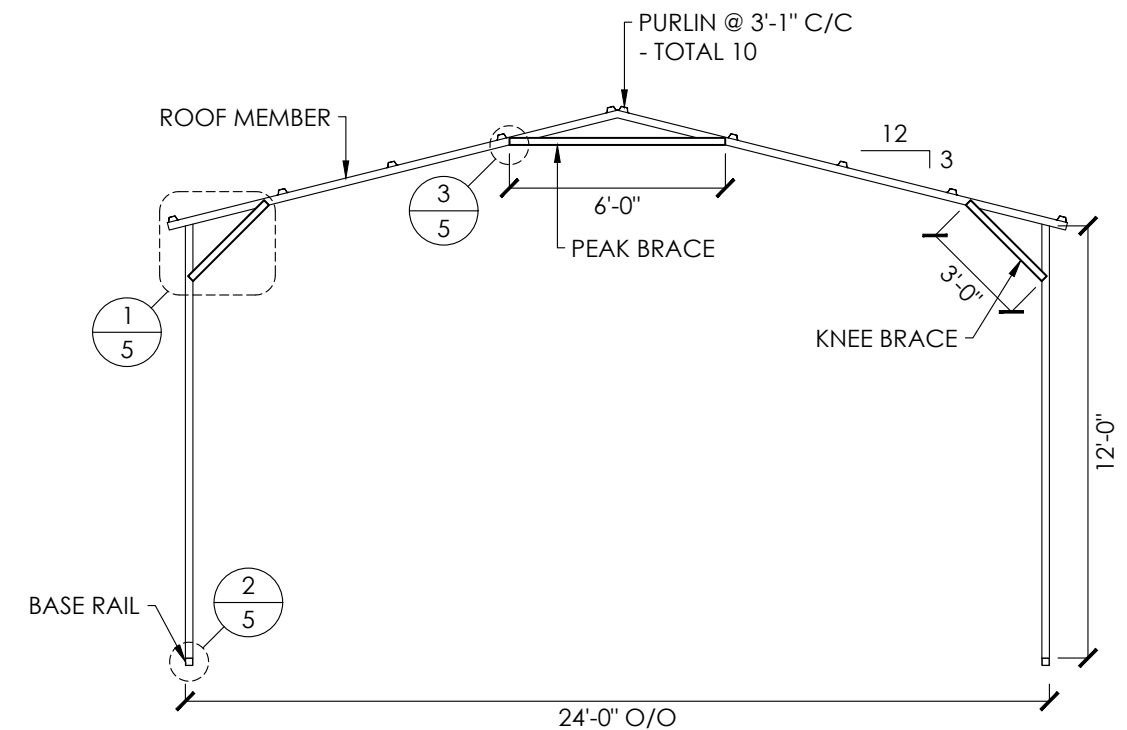


TYPICAL FRAME
SCALE: 3/16" : 1'


MEMBER PROPERTIES	
COLUMN POST	2 1/2" SQ. X 14GA TUBE
ROOF MEMBER	2 1/2" SQ. X 14GA TUBE
BASE RAIL	2 1/2" SQ. X 14GA TUBE
PEAK BRACE	2 1/2" X 14GA CHANNEL
KNEE BRACE	2 1/2" X 14GA CHANNEL
CONNECTOR SLEEVE	2 1/4" SQ. X 12GA TUBE
GIRTS	4" X 1" X 14GA HAT CHANNEL
PURLINS	4" X 1" X 14GA HAT CHANNEL

SHEATHING FASTENER SCHEDULE				
LOCATION	CORNER PANEL	SIDE LAPS	EDGE LAPS	ELSEWHERE
SPACING	9" CC	MIN. 1	4 1/2" CC	9" CC


REF. DESIGN NOTE ON SHEET 2 FOR SHEATHING FASTENER TYPE.

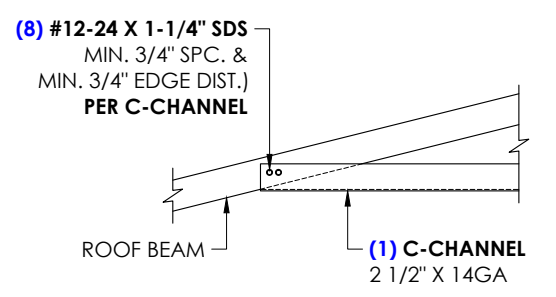

3 PEAK BRACE DETAIL
SCALE: 3/4" : 1'

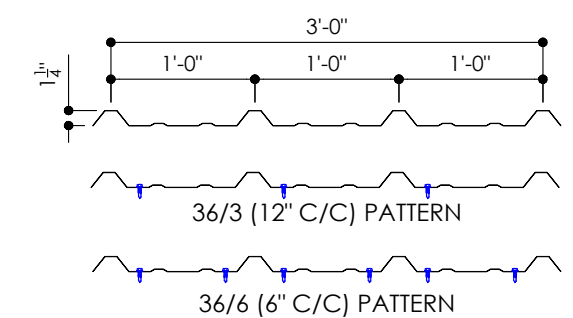

26GA. - 1 1/4" RIB - CORRUGATED SHEET
SCALE: 3/4" : 1'

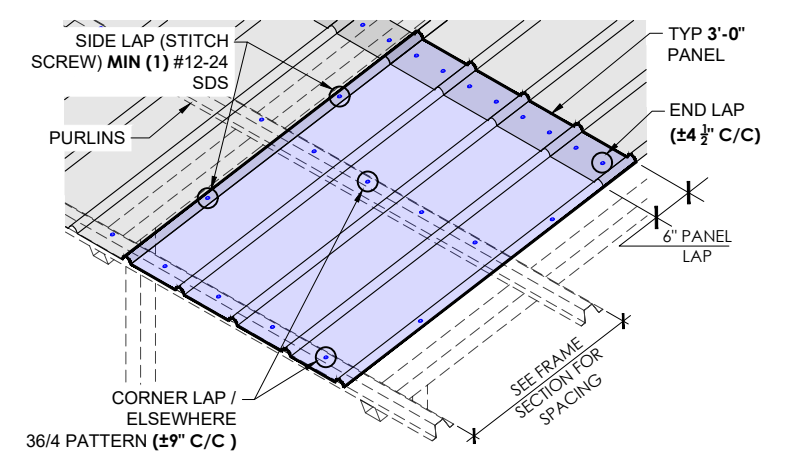

SHEATHING FASTENER PATTERN
SCALE: 3/16" : 1'


WARNING: Unauthorized copy or use of the seal below is considered forgery subject to legal action to the fullest extent of the law and/or fines.

GEORGE NAVARRO
3565 WILLOW RD
BETHEL ISLAND, CA 94511


REGISTERED PROFESSIONAL ENGINEER
RAFAEL D. SALGADO
C95761
STATE OF CALIFORNIA

GEORGE NAVARRO
3565 WILLOW RD
BETHEL ISLAND, CA 94511


EXPIRES: 03/31/2026
SIGNED: NOV 18 2024

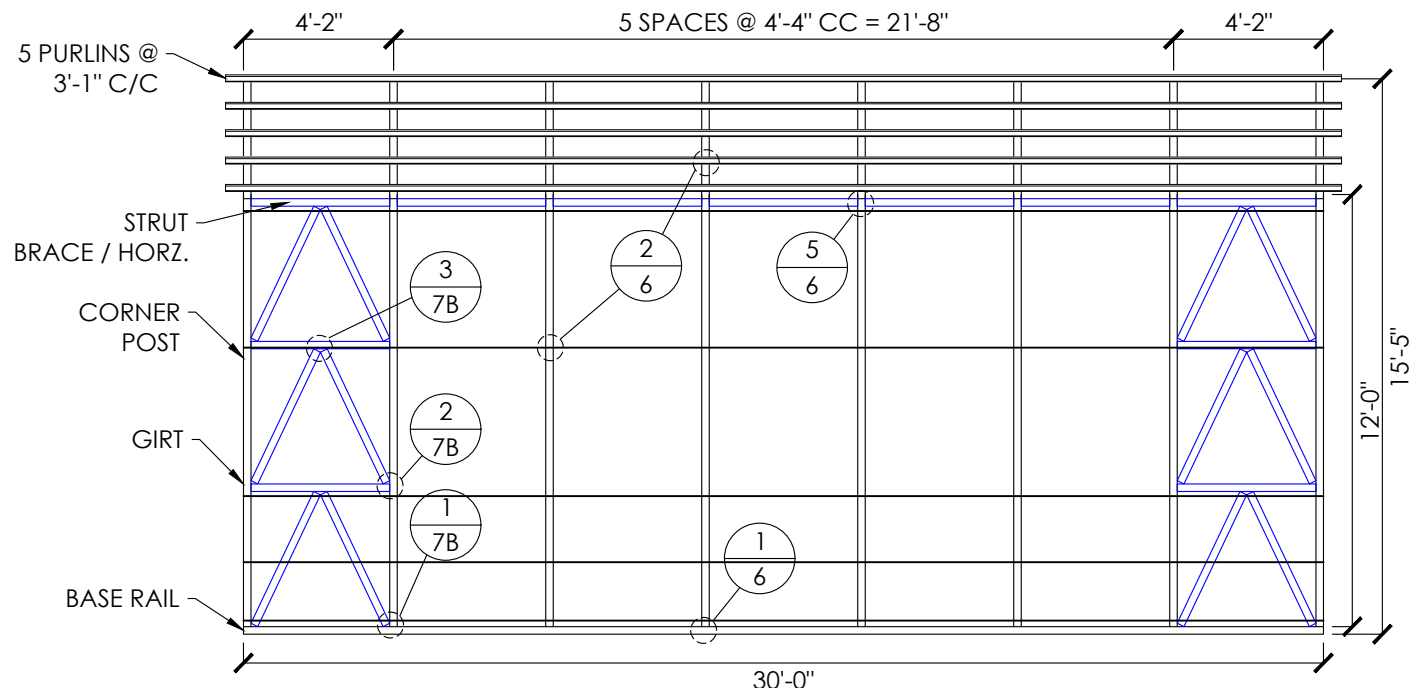


RIGHT SIDE WALL FRAMING
SCALE: 3/16" : 1'

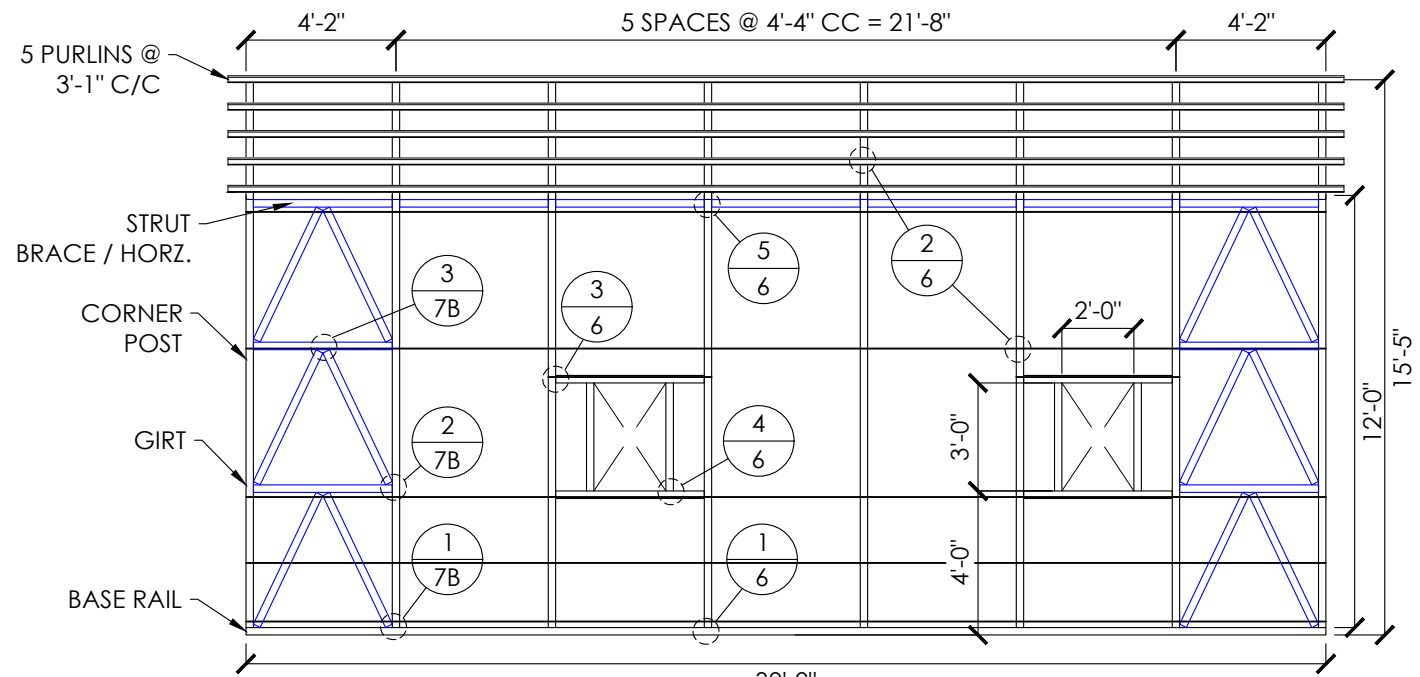


LEFT SIDE WALL FRAMING
SCALE: 3/16" : 1'

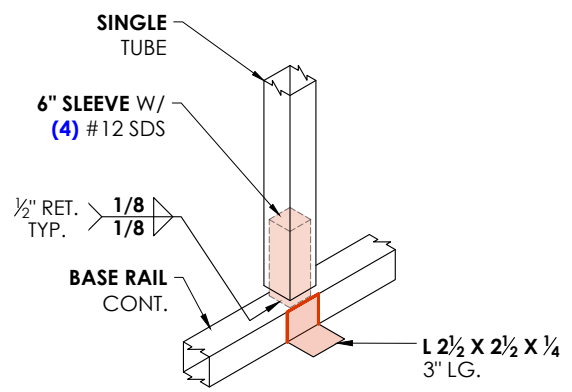


1 COLUMN-BASE DETAIL
SCALE: 3/4" : 1'

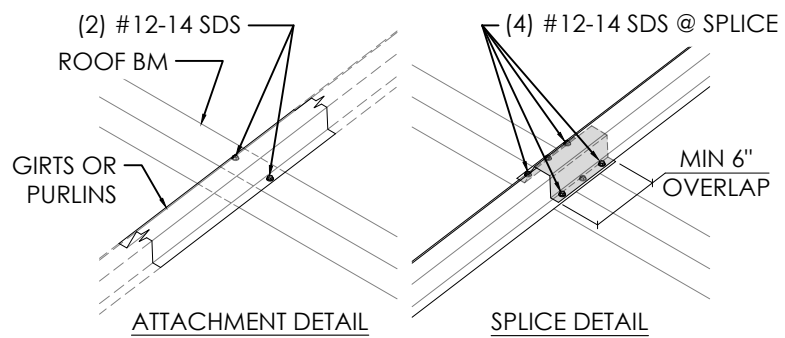


2 GIRT/PURLIN DETAIL
SCALE: 3/4" : 1'

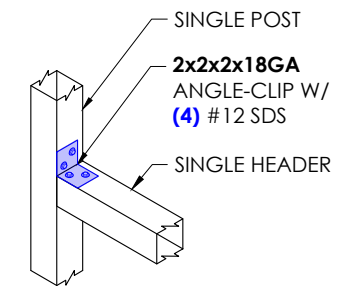

3 WINDOW DETAIL
SCALE: 3/4" : 1'

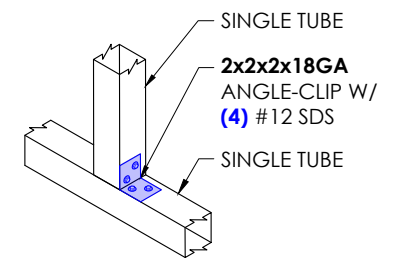

4 WINDOW DETAIL
SCALE: 3/4" : 1'

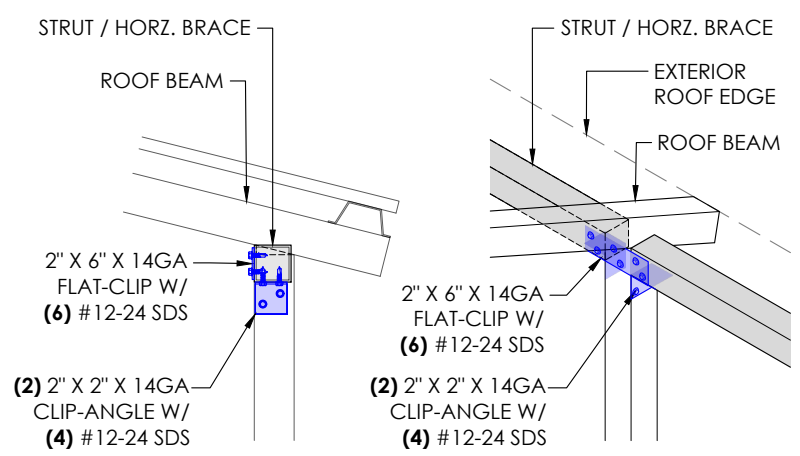

5 STRUT BRACE DETAIL
SCALE: 3/4" : 1'


MEMBER PROPERTIES	
SIDE WALL POST	2 1/2" SQ. X 14GA TUBE
BASE RAIL	2 1/2" SQ. X 14GA TUBE
CONNECTOR SLEEVE	2 1/4" SQ. X 12GA TUBE
PURLINS	4" X 1" X 14GA HAT CHANNEL
GIRTS	4" X 1" X 14GA HAT CHANNEL
WINDOW POST	2 1/2" SQ. X 14GA TUBE
HORZ. BRACE	2 1/4" SQ X 14GA TUBE
DIAGONAL BRACES	2" SQ. X 12GA TUBE

SHEET TITLE: **SIDE WALL FRAMING & DETAILS**

PROJECT TITLE: **GEORGE NAVARRO**

LOCATION: **3565 WILLOW RD
BETHEL ISLAND, CA 94511**

METAL BUILDING MANUFACTURER



WARNING: Unauthorized copy or use of the seal below is considered forgery subject to legal action to the fullest extent of the law and/or fines.

GEORGE NAVARRO
3565 WILLOW RD
BETHEL ISLAND, CA 94511

GEORGE NAVARRO
3565 WILLOW RD
BETHEL ISLAND, CA 94511

GEORGE NAVARRO
3565 WILLOW RD
BETHEL ISLAND, CA 94511

GEORGE NAVARRO
3565 WILLOW RD
BETHEL ISLAND, CA 94511

GEORGE NAVARRO
3565 WILLOW RD
BETHEL ISLAND, CA 94511
EXPIRES: 03/31/2026
SIGNED: NOV 18 2024




MEMBER PROPERTIES	
CORNER POST	2 1/2" SQ. X 14GA TUBE
ROOF MEMBER	2 1/2" SQ. X 14GA TUBE
BASE RAIL	2 1/2" SQ. X 14GA TUBE
GIRTS	4" X 1" X 14GA HAT CHANNEL
HEADER	2 1/2" SQ. X 14GA TUBE
END WALL POSTS	2 1/2" SQ. X 14GA TUBE
DIAGONAL BRACES	2" SQ. X 12GA TUBE
HORZ. BRACE	2 1/4" SQ x 14GA TUBE

SHEET TITLE: **END WALL FRAMING & DETAILS**

LOCATION: 3565 WILLOW RD
BETHEL ISLAND, CA 94511

PROJECT TITLE: **GEORGE NAVARRO**

METAL BUILDING MANUFACTURER



WARNING: Unauthorized copy or use of the seal below is considered forgery subject to legal action to the fullest extent of the law and/or fines.





GEORGE NAVARRO
3565 WILLOW RD
BETHEL ISLAND, CA 94511


GEORGE NAVARRO CIVIL ENGINEER
3565 WILLOW RD
BETHEL ISLAND, CA 94511

GEORGE NAVARRO
3565 WILLOW RD
BETHEL ISLAND, CA 94511


GEORGE NAVARRO
3565 WILLOW RD
BETHEL ISLAND, CA 94511

EXPIRES: 03/31/2026
SIGNED: NOV 18 2024

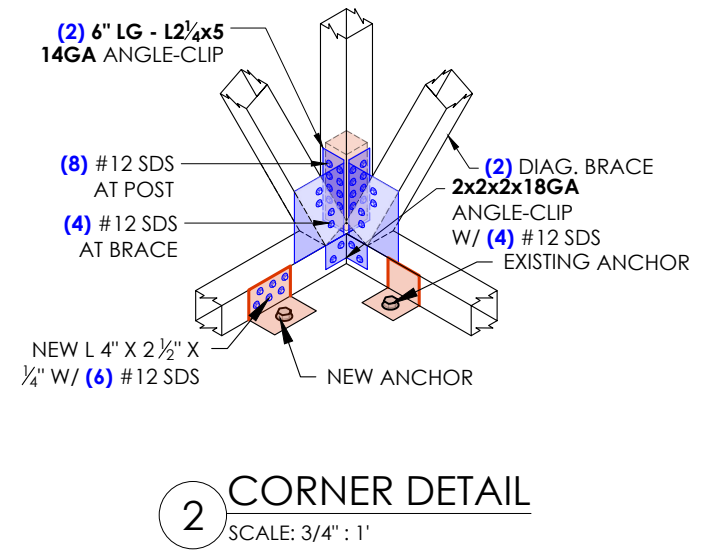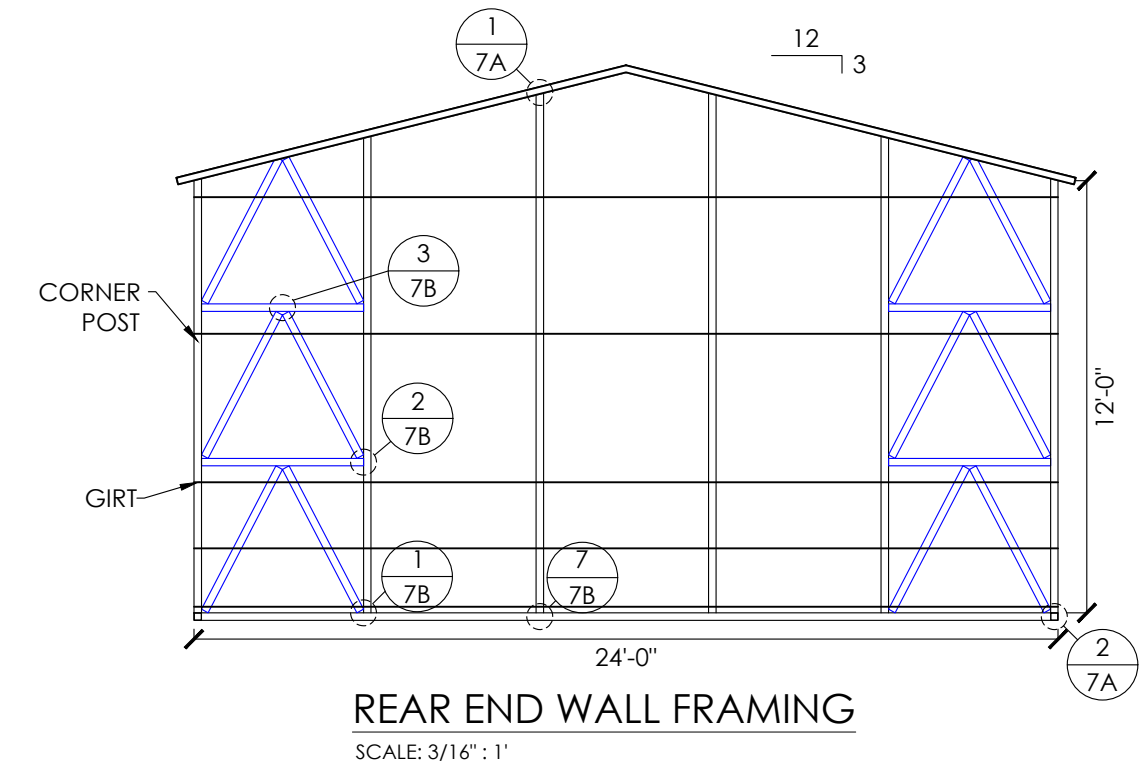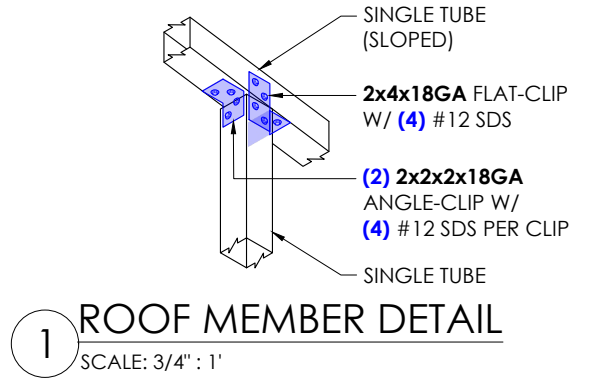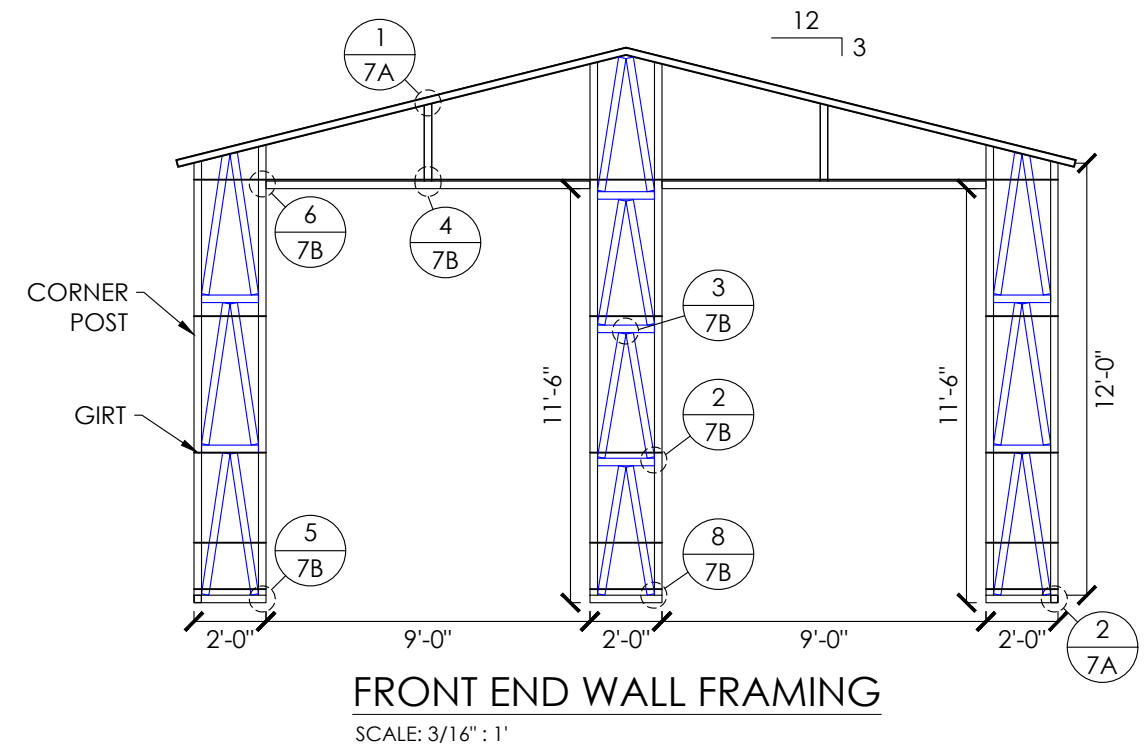


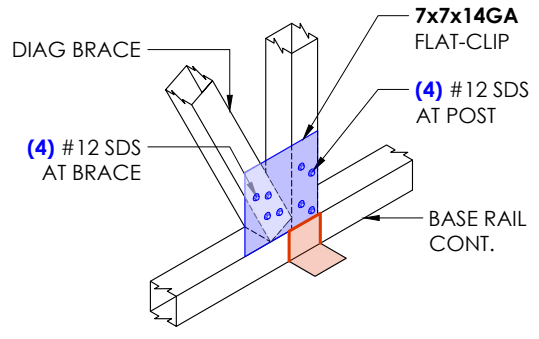


1 LATTICE BRACE DETAIL
 SCALE: 3/4" : 1'

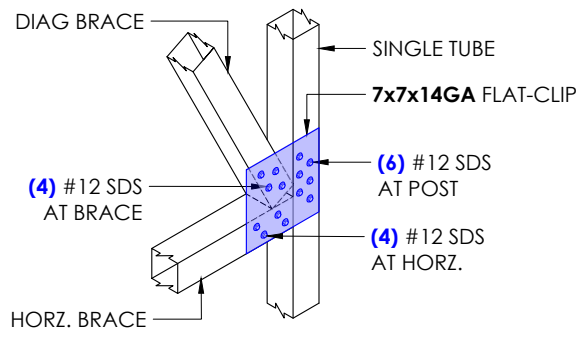


2 LATTICE BRACE DETAIL
 SCALE: 3/4" : 1'

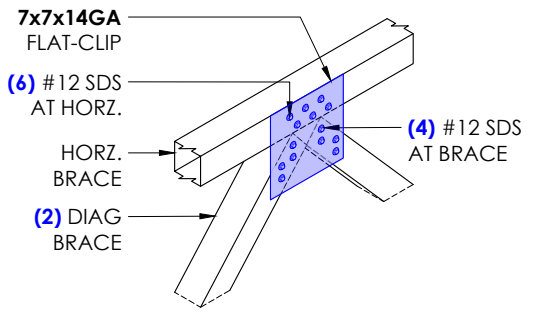


3 LATTICE BRACE DETAIL
 SCALE: 3/4" : 1'

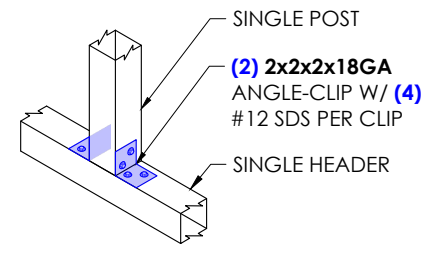


4 ABOVE HEADER DETAIL
 SCALE: 3/4" : 1'

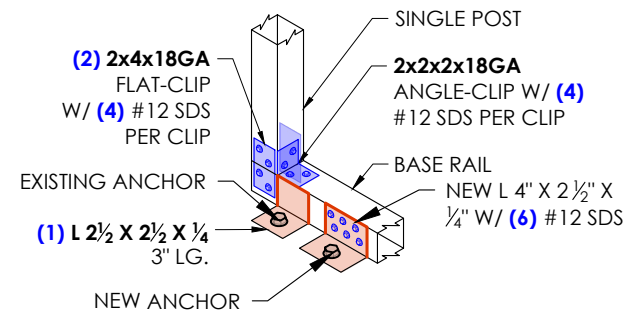


5 DOOR BASE DETAIL
 SCALE: 3/4" : 1'

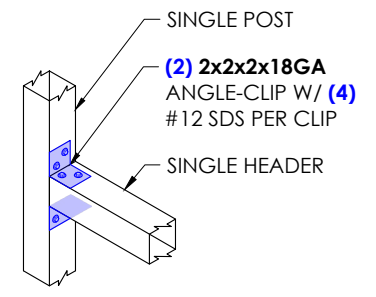

6 DOOR HEADER DETAIL
 SCALE: 3/4" : 1'

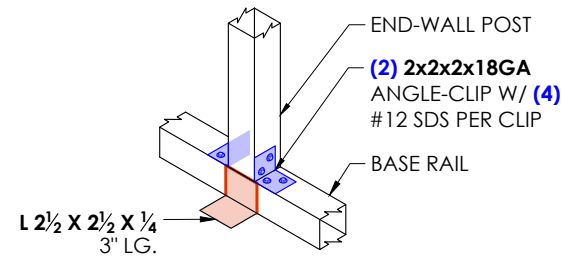

7 COLUMN-BASE DETAIL
 SCALE: 3/4" : 1'

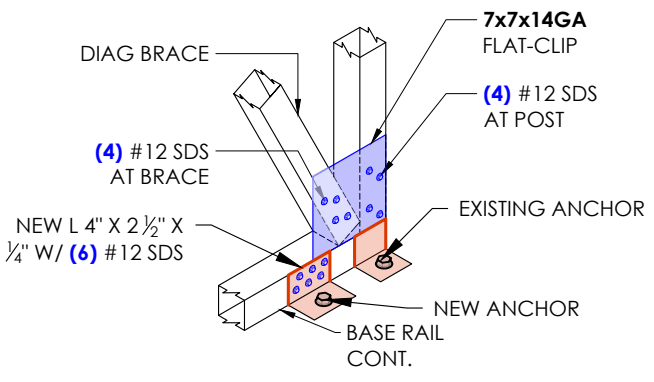


8 LATTICE BRACE DETAIL
 SCALE: 3/4" : 1'

SHEET TITLE: **END WALL FRAMING DETAILS**

PROJECT LOCATION: 3565 WILLOW RD
 BETHEL ISLAND, CA 94511

PROJECT TITLE: GEORGE NAVARRO

METAL BUILDING MANUFACTURER



WARNING: Unauthorized copy or use of the seal below is considered forgery subject to legal action to the fullest extent of the law and/or fines.

GEORGE NAVARRO
 3565 WILLOW RD
 BETHEL ISLAND, CA 94511
 REGISTERED PROFESSIONAL ENGINEER
 CIVIL
RAFAEL D. SALGADO
 C95761
 STATE OF CALIFORNIA

GEORGE NAVARRO
 3565 WILLOW RD
 BETHEL ISLAND, CA 94511
 EXPIRES: 03/31/2026
 SIGNED: NOV 18 2024